


# KOSTAC/DL Series CCM SIO Driver

1	System Configuration.....	3
2	Selection of External Device .....	10
3	Example of Communication Setting.....	11
4	Setup Items .....	62
5	Cable Diagram .....	67
6	Supported Device.....	85
7	Device Code and Address Code.....	95
8	Error Messages.....	98

## Introduction

This manual describes how to connect the Display and the External Device.

In this manual, the connection procedure will be described by following the sections below:

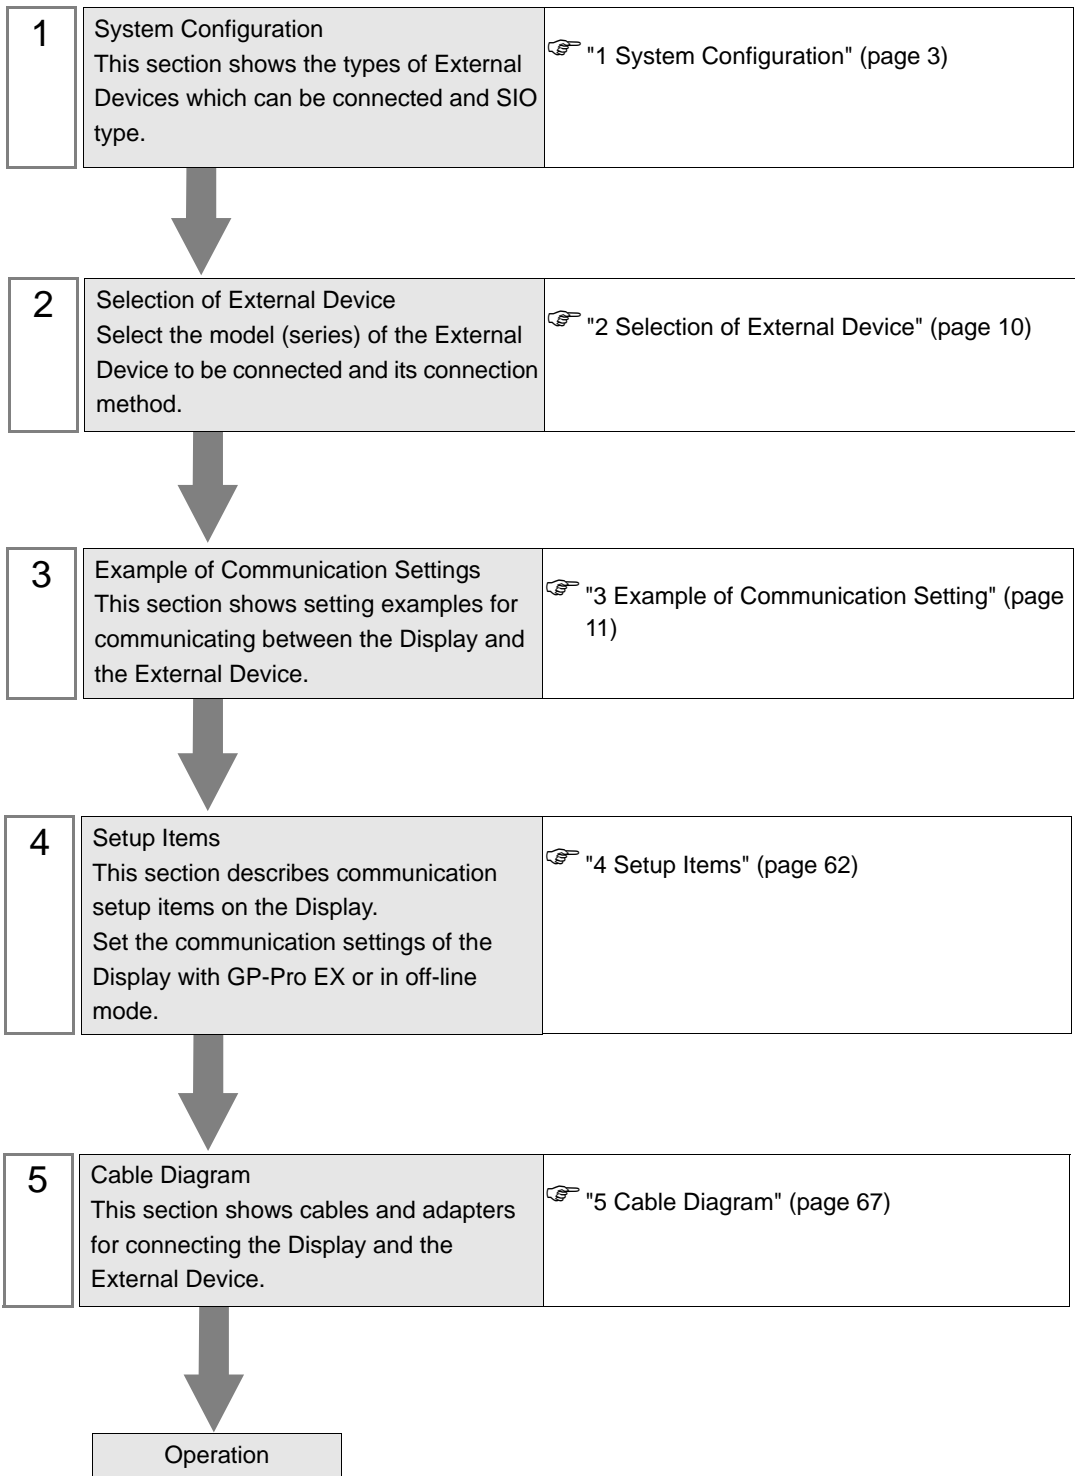

# 1 System Configuration

The following shows the system configuration where the External Device of KOYO ELECTRONICS CO., LTD. and the Display are connected.

Series	CPU	Link I/F	SIO Type	Setting Example	Cable Diagram
KOSTAC SG	SG-8	CN1 on G-01DM	RS232C	Setting Example 1 (page 11)	Cable Diagram 1 (page 67)
		CN2 on G-01DM	RS232C	Setting Example 2 (page 13)	Cable Diagram 1 (page 67)
			RS422/485 (4wire)	Setting Example 3 (page 15)	Cable Diagram 2 (page 68)
		General-purpose communication port on CPU*1	RS232C	Setting Example 4 (page 17)	Cable Diagram 1 (page 67)
			RS422/485 (4wire)	Setting Example 5 (page 19)	Cable Diagram 3 (page 73)

Series	CPU	Link I/F	SIO Type	Setting Example	Cable Diagram
KOSTAC SU	SU-5	U-01DM	RS232C	Setting Example 6 (page 21)	Cable Diagram 1 (page 67)
			RS422/485 (4wire)	Setting Example 7 (page 23)	Cable Diagram 2 (page 68)
	SU-5E SU-6 SU-6B SU-6B-C	U-01DM	RS232C	Setting Example 6 (page 21)	Cable Diagram 1 (page 67)
			RS422/485 (4wire)	Setting Example 7 (page 23)	Cable Diagram 2 (page 68)
		General-purpose communication port on CPU	RS232C	Setting Example 8 (page 25)	Cable Diagram 1 (page 67)
			RS422/485 (4wire)	Setting Example 9 (page 27)	Cable Diagram 3 (page 73)
	SU-5M SU-5M-C	U-01DM	RS232C	Setting Example 6 (page 21)	Cable Diagram 1 (page 67)
			RS422/485 (4wire)	Setting Example 7 (page 23)	Cable Diagram 2 (page 68)
		General-purpose communication port 1 on CPU	RS232C	Setting Example 10 (page 29)	Cable Diagram 1 (page 67)
			RS422/485 (4wire)	Setting Example 11 (page 31)	Cable Diagram 3 (page 73)
		General-purpose communication port 2 on CPU	RS232C	Setting Example 12 (page 33)	Cable Diagram 4 (page 76)
		General-purpose communication port 3 on CPU*2	RS422/485 (4wire)	Setting Example 13 (page 35)	Cable Diagram 6 (page 77)

Series	CPU	Link I/F	SIO Type	Setting Example	Cable Diagram
KOSTAC SU	SU-6M SU-6M-C	U-01DM	RS232C	Setting Example 6 (page 21)	Cable Diagram 1 (page 67)
			RS422/485 (4wire)	Setting Example 7 (page 23)	Cable Diagram 2 (page 68)
		General-purpose communication port 1 on CPU	RS232C	Setting Example 10 (page 29)	Cable Diagram 1 (page 67)
			RS422/485 (4wire)	Setting Example 11 (page 31)	Cable Diagram 3 (page 73)
		General-purpose communication port 2 on CPU	RS232C	Setting Example 12 (page 33)	Cable Diagram 4 (page 76)
		General-purpose communication port 3 on CPU (when using D-sub 25 pin) <sup>*2</sup>	RS422/485 (4wire)	Setting Example 13 (page 35)	Cable Diagram 6 (page 77)
		General-purpose communication port 3 on CPU (when using 6-pin terminal block) <sup>*2</sup>	RS422/485 (4wire)	Setting Example 13 (page 35)	Cable Diagram 7 (page 79)
KOSTAC SZ	SZ-4	General-purpose communication port on CPU	RS232C	Setting Example 14 (page 37)	Cable Diagram 4 (page 76)
KOSTAC PZ3	PZ3-16ND1-16TD1 PZ3-T PZ3M	General-purpose communication port 2 on CPU	RS232C	Setting Example 25 (page 58)	Cable Diagram 8 (page 81)
			RS422/485 (4wire)	Setting Example 26 (page 60)	Cable Diagram 9 (page 82)
KOSTAC SR	SR-21 SR-22	E-02DM-R1	RS422/485 (4wire)	Setting Example 15 (page 39)	Cable Diagram 2 (page 68)

Series	CPU	Link I/F	SIO Type	Setting Example	Cable Diagram
DL-205	D2-240	General-purpose communication port 2 on CPU	RS232C	Setting Example 16 (page 41)	Cable Diagram 4 (page 76)
	D2-250-1	General-purpose communication port 2 on CPU	RS232C	Setting Example 16 (page 41)	Cable Diagram 8 (page 81)
	D2-260	General-purpose communication port 2 on CPU	RS232C	Setting Example 16 (page 41)	Cable Diagram 8 (page 81)
			RS422/485 (4wire)	Setting Example 17 (page 43)	Cable Diagram 9 (page 82)
DL-405	D4--430	D4-DCM	RS232C	Setting Example 18 (page 45)	Cable Diagram 1 (page 67)
			RS422/485 (4wire)	Setting Example 19 (page 47)	Cable Diagram 2 (page 68)
	D4-440	D4-DCM	RS232C	Setting Example 18 (page 45)	Cable Diagram 1 (page 67)
			RS422/485 (4wire)	Setting Example 19 (page 47)	Cable Diagram 2 (page 68)
		General-purpose communication port on CPU	RS232C	Setting Example 20 (page 49)	Cable Diagram 1 (page 67)
			RS422/485 (4wire)	Setting Example 21 (page 51)	Cable Diagram 3 (page 73)
DL-305	D3-330	D3-DCM	RS422/485 (4wire)	Setting Example 22 (page 53)	Cable Diagram 2 (page 68)
DirectLogic 05	D0-05AA D0-05AD D0-05AR D0-05DA D0-05DD D0-05DD-D D0-05DR D0-05DR-D	General-purpose communication port on CPU	RS232C	Setting Example 23 (page 55)	Cable Diagram 5 (page 76)

Series	CPU	Link I/F	SIO Type	Setting Example	Cable Diagram
DirectLogic 06	D0-06DD1 D0-06DD1-D D0-06DD2 D0-06DD2-D D0-06DR D0-06DR-D D0-06DA D0-06AR D0-06AA	General-purpose communication port on CPU	RS232C	Setting Example 24 (page 57)	Cable Diagram 5 (page 76)

\*1 Remove the instruction word programmer from the programmer communication port during communication.


\*2 Use a CPU whose sub CPU version is V1.439 or later.

### ■ Connection Configuration

- 1:1 Connection



- 1:n Connection

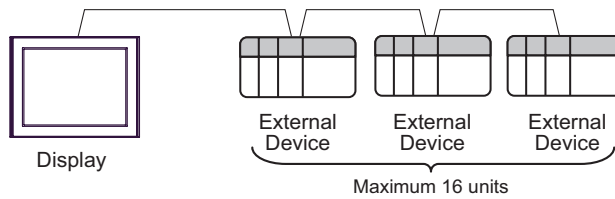

## ■ COM Port of IPC

When connecting IPC with External Device, the COM port which can be used changes with series and SIO type. Please refer to the manual of IPC for details.

### Usable port

Series	Usable port		
	RS-232C	RS-422/485(4 wire)	RS-422/485(2 wire)
PS-2000B	COM1 <sup>*1</sup> , COM2, COM3 <sup>*1</sup> , COM4	-	-
PS-3450A, PS-3451A	COM1, COM2 <sup>*1*2</sup>	COM2 <sup>*1*2</sup>	COM2 <sup>*1*2</sup>
PS-3650A, PS-3651A	COM1 <sup>*1</sup>	-	-
PS-3700A (Pentium®4-M) PS-3710A	COM1 <sup>*1</sup> , COM2 <sup>*1</sup> , COM3 <sup>*2</sup> , COM4	COM3 <sup>*2</sup>	COM3 <sup>*2</sup>
PS-3711A	COM1 <sup>*1</sup> , COM2 <sup>*2</sup>	COM2 <sup>*2</sup>	COM2 <sup>*2</sup>
PL-3000B	COM1 <sup>*1*2</sup> , COM2 <sup>*1</sup> , COM3, COM4	COM1 <sup>*1*2</sup>	COM1 <sup>*1*2</sup>

\*1 The RI/5V can be switched. Please switch with the change switch of IPC.

\*2 It is necessary to set up the SIO type with the Dip switch. Please set up as follows according to SIO type to be used.

### Dip switch setting: RS-232C

Dip switch	Setting	Description
1	OFF <sup>*1</sup>	Reserve (always OFF)
2	OFF	SIO type: RS-232C
3	OFF	
4	OFF	Output mode of SD (TXD) data: Always output
5	OFF	Terminal resistance (220Ω) insertion to SD (TXD): None
6	OFF	Terminal resistance (220Ω) insertion to RD (RXD): None
7	OFF	Short-circuit of SDA (TXA) and RDA (RXA): Does not Exist
8	OFF	Short-circuit of SDB (TXB) and RDB (RXB): Does not Exist
9	OFF	RS (RTS) Auto control mode: Disable
10	OFF	

\*1 It is necessary to turn ON the set value, only when using PS-3450A and PS-3451A.



## Dip switch setting: RS-422/485 (4 wire)


Dip switch	Setting	Description
1	OFF	Reserve (always OFF)
2	ON	SIO type: RS-422/485
3	ON	
4	OFF	Output mode of SD (TXD) data: Always output
5	OFF	Terminal resistance (220Ω) insertion to SD (TXD): None
6	OFF	Terminal resistance (220Ω) insertion to RD (RXD): None
7	OFF	Short-circuit of SDA (TXA) and RDA (RXA): Does not Exist
8	OFF	Short-circuit of SDB (TXB) and RDB (RXB): Does not Exist
9	OFF	RS (RTS) Auto control mode: Disable
10	OFF	


## Dip switch setting: RS-422/485 (2 wire)

Dip switch	Setting	Description
1	OFF	Reserve (always OFF)
2	ON	SIO type: RS-422/485
3	ON	
4	OFF	Output mode of SD (TXD) data: Always output
5	OFF	Terminal resistance (220Ω) insertion to SD (TXD): None
6	OFF	Terminal resistance (220Ω) insertion to RD (RXD): None
7	ON	Short-circuit of SDA (TXA) and RDA (RXA): Exist
8	ON	Short-circuit of SDB (TXB) and RDB (RXB): Exist
9	ON	RS (RTS) Auto control mode: Enable
10	ON	

## 2 Selection of External Device

Select the External Device to be connected to the Display.

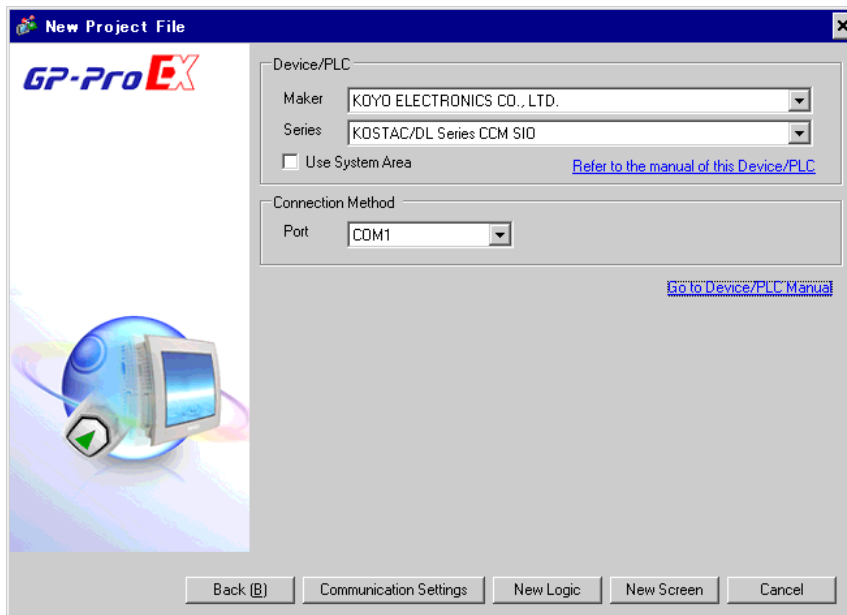

Setup Items	Setup Description
Maker	Select the maker of the External Device to be connected. Select "KOYO ELECTRONICS CO., LTD."
Series	Select the model (series) of the External Device to be connected and its connection method. Select "KOSTAC/DL Series CCM SIO". Check the External Device which can be connected in "KOSTAC/DL Series CCM SIO" in system configuration.  "1 System Configuration" (page 3)
Use System Area	Check this option when you synchronize the system data area of the Display and the device (memory) of the External Device. When they are synchronized, you can use the ladder program of the External Device to switch the display or to display the window on the Display. Cf. GP-Pro EX Reference Manual "Appendix 1.4 LS Area (only for direct access method)" This can also be set with GP-Pro EX or in off-line mode of the Display. Cf. GP-Pro EX Reference Manual "5.14.6 Setting Guide of [System Setting Window], Setting Guide of [Main Unit Settings], System Area Setting" Cf. Maintenance/Troubleshooting Manual "2.14.1 Common to the Display", Setting Guide of [Main Unit Settings], System Area Setting
Port	Select the port of the Display to be connected to the External Device.

## 3 Example of Communication Setting

The following shows examples of communication settings of the Display and the External Device, which are recommended by Digital Electronics Corp.


### 3.1 Setting Example 1

#### ■ Settings of GP-Pro EX

##### ◆ Communication Settings

To display the setting screen, select [Device/PLC Settings] from [System setting window] in workspace.

##### ◆ Device Setting

To display the setting screen, click  ([Setting]) of the External Device you want to set from [Device-Specific Settings] of [Device/PLC Settings].

## ■ Settings of External Device

For communication settings, use the DIP switches on the side of the link I/F unit. After completing the settings, reboot the External Device to enable them. Please refer to the manual of the External Device for details.

### NOTE

- If you do not use the connector CN2, make sure to switch the short plug (2) to 232C DISABLE.

### ◆ Configuration DIP Switch SW1

DIP Switch	Settings	Setup Description
1	ON	Child station No.: 1
2	OFF	
3	OFF	
4	OFF	
5	OFF	
6	OFF	
7	OFF	
8	OFF	Peer to Peer setting: 1:n mode
9	OFF	Master/Slave setting: Slave

### ◆ Configuration DIP Switch

DIP Switch	Settings	Setup Description
1	ON	Baud rate transmission speed: 19,200bps
2	ON	
3	ON	
4	ON	Parity enable/disable: Enabled (odd)
5	OFF	Self-diagnosis mode: OFF
6	OFF	Turnaround delay: None
7	OFF	Response delay time: 0 ms
8	OFF	
9	OFF	Transmission mode: HEX mode


## 3.2 Setting Example 2

### ■ Settings of GP-Pro EX

#### ◆ Communication Settings

To display the setting screen, select [Device/PLC Settings] from [System setting window] in workspace.

#### ◆ Device Setting

To display the setting screen, click  ([Setting]) of the External Device you want to set from [Device-Specific Settings] of [Device/PLC Settings].

## ■ Settings of External Device

For communication settings, use the DIP switches or the short plug on the side of the link I/F unit. After completing the settings, reboot the External Device to enable them. Please refer to the manual of the External Device for details.

### ◆ Configuration DIP Switch SW1

DIP Switch	Settings	Setup Description
1	ON	Child station No.: 1
2	OFF	
3	OFF	
4	OFF	
5	OFF	
6	OFF	
7	OFF	
8	OFF	Peer to Peer setting: 1:n mode
9	OFF	Master/Slave setting: Slave

### ◆ Configuration DIP Switch

DIP Switch	Settings	Setup Description
1	ON	Baud rate transmission speed: 19,200bps
2	ON	
3	ON	
4	ON	Parity enable/disable: Enabled (odd)
5	OFF	Self-diagnosis mode: OFF
6	OFF	Turnaround delay: None
7	OFF	Response delay time: 0 ms
8	OFF	
9	OFF	Transmission mode: HEX mode

### ◆ Short plug (2)

Short plug	Setup Description
232C ENABLE	SIO Type: RS232C


### 3.3 Setting Example 3

#### ■ Settings of GP-Pro EX

##### ◆ Communication Settings

To display the setting screen, select [Device/PLC Settings] from [System setting window] in workspace.

##### ◆ Device Setting

To display the setting screen, click  ([Setting]) of the External Device you want to set from [Device-Specific Settings] of [Device/PLC Settings].

## ■ Settings of External Device

For communication settings, use the DIP switches or the short plug on the side of the link I/F unit. After completing the settings, reboot the External Device to enable them. Please refer to the manual of the External Device for details.

### ◆ Configuration DIP Switch SW1

DIP Switch	Settings	Setup Description
1	ON	Child station No.: 1
2	OFF	
3	OFF	
4	OFF	
5	OFF	
6	OFF	
7	OFF	
8	OFF	Peer to Peer setting: 1:n mode
9	OFF	Master/Slave setting: Slave

### ◆ Configuration DIP Switch

DIP Switch	Settings	Setup Description
1	ON	Baud rate transmission speed: 19,200bps
2	ON	
3	ON	
4	ON	Parity enable/disable: Enabled (odd)
5	OFF	Self-diagnosis mode: OFF
6	OFF	Turnaround delay: None
7	OFF	Response delay time: 0 ms
8	OFF	
9	OFF	Transmission mode: HEX mode

### ◆ Short plug (2)

Short plug	Setup Description
232C DISABLE	SIO Type: RS422




## 3.4 Setting Example 4

### ■ Settings of GP-Pro EX

#### ◆ Communication Settings

To display the setting screen, select [Device/PLC Settings] from [System setting window] in workspace.

#### ◆ Device Setting

To display the setting screen, click  ([Setting]) of the External Device you want to set from [Device-Specific Settings] of [Device/PLC Settings].

## ■ Settings of External Device

For communication settings, use the DIP switches on the CPU unit. To set the station No., use the instruction word programmer (S-01P). After completing the settings, reboot the External Device to enable them. Please refer to the manual of the External Device for details.

### ◆ Communication Setting Switch

DIP Switch	Settings	Setup Description
SW1	ON	SIO Type: RS232C
SW2	OFF	CCM station No. setting: Enabled
SW3	ON	Baud rate transmission speed: 19,200bps
SW4	ON	

#### NOTE

- Setting SW2 to ON switches the transmission mode to ASCII mode and thus disables communication. Make sure to set it to OFF and set the CCM station No. and transmission mode.

### ◆ CCM Station No. Setting

- Select Menu 56. Press [Clear], [5], [6], [Menu], and then press the Enter key.
- Enter the CCM station No. Press [0], [1], and then press the Enter key.

#### NOTE

- Enter the station No. set on the Display.

- Set the transmission mode to "HEX", and then press the Enter key.


## 3.5 Setting Example 5

### ■ Settings of GP-Pro EX

#### ◆ Communication Settings

To display the setting screen, select [Device/PLC Settings] from [System setting window] in workspace.

#### ◆ Device Setting

To display the setting screen, click  ([Setting]) of the External Device you want to set from [Device-Specific Settings] of [Device/PLC Settings].

## ■ Settings of External Device

For communication settings, use the DIP switches on the CPU unit. To set the station No., use the instruction word programmer (S-01P). After completing the settings, reboot the External Device to enable them. Please refer to the manual of the External Device for details.

### ◆ Communication Setting Switch

DIP Switch	Settings	Setup Description
SW1	OFF	SIO Type: RS422
SW2	OFF	CCM station No. setting: Enabled
SW3	ON	Baud rate transmission speed: 19,200bps
SW4	ON	

#### NOTE

- Setting SW2 to ON switches the transmission mode to ASCII mode and thus disables communication. Make sure to set it to OFF and set the CCM station No. and transmission mode.

### ◆ CCM Station No. Setting

- 1 Select Menu 56. Press [Clear], [5], [6], [Menu], and then press the Enter key.
- 2 Enter the CCM station No. Press [0], [1], and then press the Enter key.

#### NOTE

- Enter the station No. set on the Display.

- 3 Set the transmission mode to "HEX", and then press the Enter key.

## 3.6 Setting Example 6

### ■ Settings of GP-Pro EX

#### ◆ Communication Settings

To display the setting screen, select [Device/PLC Settings] from [System setting window] in workspace.

Device/PLC 1

Summary [Change Device/PLC](#)

Maker  Series  Port

Text Data Mode  [Change](#)

Communication Settings

SIO Type  RS232C  RS422/485(2wire)  RS422/485(4wire)

Speed

Data Length  7  8

Parity  NONE  EVEN  ODD

Stop Bit  1  2

Flow Control  NONE  ER(DTR/CTS)  XON/XOFF

Timeout  (sec)

Retry

Wait To Send  (ms)

RI / VCC  RI  VCC

In the case of RS232C, you can select the 9th pin to RI (Input) or VCC (5V Power Supply). If you use the Digital's RS232C Isolation Unit, please select it to VCC.

Device-Specific Settings

Allowable Number of Devices/PLCs

Number	Device Name	Settings
<input type="text" value="1"/>	<input type="text" value="PLC1"/>	<input type="button" value="Settings"/> Series=KOSTAC SG/SU/SZ Series, Station No=1

#### ◆ Device Setting

To display the setting screen, click ([Setting]) of the External Device you want to set from [Device-Specific Settings] of [Device/PLC Settings].

Individual Device Settings

PLC1

Series

Please reconfirm all of address settings that you are using if you have changed the series.

Station No

## ■ Settings of External Device

For communication settings, use the rotary switch on the front of the link I/F unit, or the DIP switches on its back. After completing the settings, reboot the External Device to enable them. Please refer to the manual of the External Device for details.

### ◆ Station No. Setting Rotary Switch

Rotary Switch	Settings	Setup Description
x10	0	Station No. of the External Device (tens digit)
x1	1	Station No. of the External Device (ones digit)

#### NOTE

- Enter the station No. set on the Display.

### ◆ Configuration DIP Switch SW4

DIP Switch	Settings	Setup Description
1	ON	Baud rate transmission speed: 19,200bps
2	ON	
3	ON	
4	ON	Parity enable/disable: Enabled (odd)
5	OFF	Self-diagnosis mode: OFF
6	OFF	Response delay time: 0 ms
7	OFF	
8	OFF	

### ◆ Configuration DIP Switch SW5

DIP Switch	Settings	Setup Description
1	OFF	Peer to Peer setting: 1:n mode
2	OFF	Master/Slave setting: Slave
3	OFF	Timeout enable/disable setting: Normal operation mode
4	OFF	Transmission mode: HEX mode

## 3.7 Setting Example 7

### ■ Settings of GP-Pro EX

#### ◆ Communication Settings

To display the setting screen, select [Device/PLC Settings] from [System setting window] in workspace.

Device/PLC 1

Summary [Change Device/PLC](#)

Maker  Series  Port

Text Data Mode  [Change](#)

Communication Settings

SIO Type  RS232C  RS422/485(2wire)  RS422/485(4wire)

Speed

Data Length  7  8

Parity  NONE  EVEN  ODD

Stop Bit  1  2

Flow Control  NONE  ER(DTR/CTS)  XON/XOFF

Timeout  (sec)

Retry

Wait To Send  (ms)

RI / VCC  RI  VCC

In the case of RS232C, you can select the 9th pin to RI (Input) or VCC (5V Power Supply). If you use the Digital's RS232C Isolation Unit, please select it to VCC.

Device-Specific Settings

Allowable Number of Devices/PLCs

Number	Device Name	Settings
<input type="text" value="1"/>	<input type="text" value="PLC1"/>	<input type="button" value="Settings"/>

Series=KOSTAC SG/SU/SZ Series, Station No=1

#### ◆ Device Setting

To display the setting screen, click  ([Setting]) of the External Device you want to set from [Device-Specific Settings] of [Device/PLC Settings].

Individual Device Settings

PLC1

Series

Please reconfirm all of address settings that you are using if you have changed the series.

Station No

## ■ Settings of External Device

For communication settings, use the rotary switch on the front of the link I/F unit, or the DIP switches on its back. After completing the settings, reboot the External Device to enable them. Please refer to the manual of the External Device for details.

### ◆ Station No. Setting Rotary Switch

Rotary Switch	Settings	Setup Description
x10	0	Station No. of the External Device (tens digit)
x1	1	Station No. of the External Device (ones digit)

#### NOTE

- Enter the station No. set on the Display.

### ◆ Configuration DIP Switch SW4

DIP Switch	Settings	Setup Description
1	ON	Baud rate transmission speed: 19,200bps
2	ON	
3	ON	
4	ON	Parity enable/disable: Enabled (odd)
5	OFF	Self-diagnosis mode: OFF
6	OFF	Response delay time: 0 ms
7	OFF	
8	OFF	

### ◆ Configuration DIP Switch SW5

DIP Switch	Settings	Setup Description
1	OFF	Peer to Peer setting: 1:n mode
2	OFF	Master/Slave setting: Slave
3	OFF	Timeout enable/disable setting: Normal operation mode
4	OFF	Transmission mode: HEX mode




## 3.8 Setting Example 8

### ■ Settings of GP-Pro EX

#### ◆ Communication Settings

To display the setting screen, select [Device/PLC Settings] from [System setting window] in workspace.

#### ◆ Device Setting

To display the setting screen, click  ([Setting]) of the External Device you want to set from [Device-Specific Settings] of [Device/PLC Settings].

## ■ Settings of External Device

For communication settings, use the DIP switches on the CPU unit. To set the station No., use the instruction word programmer (S-01P). After completing the settings, reboot the External Device to enable them. Please refer to the manual of the External Device for details.

### ◆ Communication Setting Switch

DIP Switch	Settings	Setup Description
SW1	Optional	Battery mode: Adjust to the system.
SW2	OFF	CCM station No. setting: Enabled
SW3	ON	Baud rate transmission speed: 19,200bps
SW4	ON	

#### NOTE

- Setting SW2 to ON switches the transmission mode to ASCII mode and thus disables communication. Make sure to set it to OFF and set the CCM station No. and transmission mode.

### ◆ CCM Station No. Setting

- 1 Select Menu 56. Press [Clear], [5], [6], [Menu], and then press the Enter key.
- 2 Enter the CCM station No. Press [0], [1], and then press the Enter key.

#### NOTE

- Enter the station No. set on the Display.

- 3 Set the transmission mode to "HEX", and then press the Enter key.
- 4 Set the parity to "ODD", and then press the Enter key.


### 3.9 Setting Example 9

#### ■ Settings of GP-Pro EX

##### ◆ Communication Settings

To display the setting screen, select [Device/PLC Settings] from [System setting window] in workspace.

##### ◆ Device Setting

To display the setting screen, click  ([Setting]) of the External Device you want to set from [Device-Specific Settings] of [Device/PLC Settings].

## ■ Settings of External Device

For communication settings, use the DIP switches on the CPU unit. To set the station No., use the instruction word programmer (S-01P). After completing the settings, reboot the External Device to enable them. Please refer to the manual of the External Device for details.

### ◆ Communication Setting Switch

DIP Switch	Settings	Setup Description
SW1	Optional	Battery mode: Adjust to the system.
SW2	OFF	CCM station No. setting: Enabled
SW3	ON	Baud rate transmission speed: 19,200bps
SW4	ON	

#### NOTE

- Setting SW2 to ON switches the transmission mode to ASCII mode and thus disables communication. Make sure to set it to OFF and set the CCM station No. and transmission mode.

### ◆ CCM Station No. Setting

- 1 Select Menu 56. Press [Clear], [5], [6], [Menu], and then press the Enter key.
- 2 Enter the CCM station No. Press [0], [1], and then press the Enter key.

#### NOTE

- Enter the station No. set on the Display.

- 3 Set the transmission mode to "HEX", and then press the Enter key.
- 4 Set the parity to "ODD", and then press the Enter key.


### 3.10 Setting Example 10

#### ■ Settings of GP-Pro EX

##### ◆ Communication Settings

To display the setting screen, select [Device/PLC Settings] from [System setting window] in workspace.

##### ◆ Device Setting

To display the setting screen, click  ([Setting]) of the External Device you want to set from [Device-Specific Settings] of [Device/PLC Settings].

## ■ Settings of External Device

For communication settings, use the DIP switches on the CPU unit. To set the station No., use the instruction word programmer (S-01P). After completing the settings, reboot the External Device to enable them. Please refer to the manual of the External Device for details.

### ◆ Communication Setting Switch

DIP Switch	Settings	Setup Description
SW1	Optional	Battery mode: Adjust to the system.
SW2	OFF	CCM station No. setting: Enabled
SW3	ON	Baud rate transmission speed: 19,200bps
SW4	ON	

#### NOTE

- Setting SW2 to ON switches the transmission mode to ASCII mode and thus disables communication. Make sure to set it to OFF and set the CCM station No. and transmission mode.

### ◆ CCM Station No. Setting

- 1 Select Menu 56. Press [Clear], [5], [6], [Menu], and then press the Enter key.
- 2 Enter the CCM station No. Press [0], [1], and then press the Enter key.

#### NOTE

- Enter the station No. set on the Display.

- 3 Set the transmission mode to "HEX", and then press the Enter key.
- 4 Set the parity to "ODD", and then press the Enter key.


### 3.11 Setting Example 11

#### ■ Settings of GP-Pro EX

##### ◆ Communication Settings

To display the setting screen, select [Device/PLC Settings] from [System setting window] in workspace.

##### ◆ Device Setting

To display the setting screen, click  ([Setting]) of the External Device you want to set from [Device-Specific Settings] of [Device/PLC Settings].

## ■ Settings of External Device

For communication settings, use the DIP switches on the CPU unit. To set the station No., use the instruction word programmer (S-01P). After completing the settings, reboot the External Device to enable them. Please refer to the manual of the External Device for details.

### ◆ Communication Setting Switch

DIP Switch	Settings	Setup Description
SW1	Optional	Battery mode: Adjust to the system.
SW2	OFF	CCM station No. setting: Enabled
SW3	ON	Baud rate transmission speed: 19,200bps
SW4	ON	

#### NOTE

- Setting SW2 to ON switches the transmission mode to ASCII mode and thus disables communication. Make sure to set it to OFF and set the CCM station No. and transmission mode.

### ◆ CCM Station No. Setting

- 1 Select Menu 56. Press [Clear], [5], [6], [Menu], and then press the Enter key.
- 2 Enter the CCM station No. Press [0], [1], and then press the Enter key.

#### NOTE

- Enter the station No. set on the Display.

- 3 Set the transmission mode to "HEX", and then press the Enter key.
- 4 Set the parity to "ODD", and then press the Enter key.




## 3.12 Setting Example 12

### ■ Settings of GP-Pro EX

#### ◆ Communication Settings

To display the setting screen, select [Device/PLC Settings] from [System setting window] in workspace.

#### ◆ Device Setting

To display the setting screen, click  ([Setting]) of the External Device you want to set from [Device-Specific Settings] of [Device/PLC Settings].

## ■ Settings of External Device

For communication settings, use the DIP switches on the CPU unit. To set the station No., use the instruction word programmer (S-01P). After completing the settings, reboot the External Device to enable them. Please refer to the manual of the External Device for details.

### ◆ Communication Setting Switch

DIP Switch	Settings	Setup Description
SW1	Optional	Battery mode: Adjust to the system.
SW2	OFF	CCM station No. setting: Enabled
SW3	ON	Baud rate transmission speed: 19,200bps
SW4	ON	

#### NOTE

- Setting SW2 to ON switches the transmission mode to ASCII mode and thus disables communication. Make sure to set it to OFF and set the CCM station No. and transmission mode.

### ◆ CCM Station No. Setting

- Select Menu 56. Press [Clear], [5], [6], [Menu], and then press the Enter key.
- Enter the CCM station No. Press [0], [1], and then press the Enter key.

#### NOTE

- Enter the station No. set on the Display.

- Set the transmission mode to "HEX", and then press the Enter key.
- Set the parity to "ODD", and then press the Enter key.


### 3.13 Setting Example 13

#### ■ Settings of GP-Pro EX

##### ◆ Communication Settings

To display the setting screen, select [Device/PLC Settings] from [System setting window] in workspace.

##### ◆ Device Setting

To display the setting screen, click  ([Setting]) of the External Device you want to set from [Device-Specific Settings] of [Device/PLC Settings].

## ■ Settings of External Device

For communication settings, use the DIP switches on the CPU unit. To set the station No., use the instruction word programmer (S-01P). After completing the settings, reboot the External Device to enable them. Please refer to the manual of the External Device for details.

### ◆ Communication Setting Switch

DIP Switch	Settings	Setup Description
SW1	Optional	Battery mode: Adjust to the system.
SW2	OFF	CCM station No. setting: Enabled
SW3	ON	Baud rate transmission speed: 19,200bps
SW4	ON	

#### NOTE

- Setting SW2 to ON switches the transmission mode to ASCII mode and thus disables communication. Make sure to set it to OFF and set the CCM station No. and transmission mode.

### ◆ CCM Station No. Setting

- 1 Select Menu 56. Press [Clear], [5], [6], [Menu], and then press the Enter key.
- 2 Enter the CCM station No. Press [0], [1], and then press the Enter key.

#### NOTE

- Enter the station No. set on the Display.

- 3 Set the transmission mode to "HEX", and then press the Enter key.
- 4 Set the parity to "ODD", and then press the Enter key.


### 3.14 Setting Example 14

#### ■ Settings of GP-Pro EX

##### ◆ Communication Settings

To display the setting screen, select [Device/PLC Settings] from [System setting window] in workspace.

##### ◆ Device Setting

To display the setting screen, click  ([Setting]) of the External Device you want to set from [Device-Specific Settings] of [Device/PLC Settings].

## ■ Settings of External Device

For communication settings, use the instruction word programmer (S-01P). After completing the settings, reboot the External Device to enable them. Please refer to the manual of the External Device for details.

---

**NOTE**

- Set the mode selector switch to TERM in the setup process.
- 

### ◆ CCM Station No. Setting

- 1 Select Menu 56. Press [Clear], [5], [6], [Menu], and then press the Enter key.
- 2 Enter the CCM station No. Press [0], [1], and then press the Enter key.

---

**NOTE**

- Enter the station No. set on the Display.
- 

- 3 Set the transmission mode to "HEX", and then press the Enter key.
- 4 Set the parity to "ODD", and then press the Enter key.
- 5 Set the transmission speed to "19200", and then press the Enter key.


### 3.15 Setting Example 15

#### ■ Settings of GP-Pro EX

##### ◆ Communication Settings

To display the setting screen, select [Device/PLC Settings] from [System setting window] in workspace.

##### ◆ Device Setting

To display the setting screen, click  ([Setting]) of the External Device you want to set from [Device-Specific Settings] of [Device/PLC Settings].

## ■ Settings of External Device

For communication settings, use the DIP switches on the side of the link I/F unit. After completing the settings, reboot the External Device to enable them. Please refer to the manual of the External Device for details.

### ◆ Configuration DIP Switch SW1

DIP Switch	Settings	Setup Description
1	ON	Baud rate transmission speed: 19,200bps
2	ON	
3	OFF	Parity enable/disable: Disabled
4	ON	Self-diagnosis mode: OFF
5	OFF	Turnaround delay: None
6	OFF	Power-on mode: Adjust to the system.
7	OFF	Always OFF
8	OFF	Transmission mode: HEX mode

### ◆ Configuration DIP Switch SW2

DIP Switch	Settings	Setup Description
1	ON	Child station No.: 1
2	OFF	
3	OFF	
4	OFF	
5	OFF	
6	OFF	
7	OFF	
8	OFF	Always OFF




### 3.16 Setting Example 16

#### ■ Settings of GP-Pro EX

##### ◆ Communication Settings

To display the setting screen, select [Device/PLC Settings] from [System setting window] in workspace.

##### ◆ Device Setting

To display the setting screen, click  ([Setting]) of the External Device you want to set from [Device-Specific Settings] of [Device/PLC Settings].

## ■ Settings of External Device

For communication settings, use the instruction word programmer (S-01P). After completing the settings, reboot the External Device to enable them. Please refer to the manual of the External Device for details.

---

**NOTE**

- Set the mode selector switch to TERM in the setup process.
- 

### ◆ CCM Station No. Setting

- 1 Select Menu 56. Press [Clear], [5], [6], [Menu], and then press the Enter key.
- 2 Enter the CCM station No. Press [0], [1], and then press the Enter key.

---

**NOTE**

- Enter the station No. set on the Display.
- 

- 3 Set the transmission mode to "HEX", and then press the Enter key.
- 4 Set the parity to "ODD", and then press the Enter key.
- 5 Set the transmission speed to "19200", and then press the Enter key.


### 3.17 Setting Example 17

#### ■ Settings of GP-Pro EX

##### ◆ Communication Settings

To display the setting screen, select [Device/PLC Settings] from [System setting window] in workspace.

##### ◆ Device Setting

To display the setting screen, click  ([Setting]) of the External Device you want to set from [Device-Specific Settings] of [Device/PLC Settings].

## ■ Settings of External Device

For communication settings, use the instruction word programmer (S-01P). After completing the settings, reboot the External Device to enable them. Please refer to the manual of the External Device for details.

---

**NOTE**

- Set the mode selector switch to TERM in the setup process.
- 

### ◆ CCM Station No. Setting

- 1 Select Menu 56. Press [Clear], [5], [6], [Menu], and then press the Enter key.
- 2 Enter the CCM station No. Press [0], [1], and then press the Enter key.

---

**NOTE**

- Enter the station No. set on the Display.
- 

- 3 Set the transmission mode to "HEX", and then press the Enter key.
- 4 Set the parity to "ODD", and then press the Enter key.
- 5 Set the transmission speed to "19200", and then press the Enter key.

### 3.18 Setting Example 18

#### ■ Settings of GP-Pro EX

##### ◆ Communication Settings

To display the setting screen, select [Device/PLC Settings] from [System setting window] in workspace.

Device/PLC 1

Summary [Change Device/PLC](#)

Maker  Series  Port

Text Data Mode  [Change](#)

Communication Settings

SID Type  RS232C  RS422/485(2wire)  RS422/485(4wire)

Speed

Data Length  7  8

Parity  NONE  EVEN  ODD

Stop Bit  1  2

Flow Control  NONE  ER(DTR/CTS)  XON/XOFF

Timeout  (sec)

Retry

Wait To Send  (ms)

RI / VCC  RI  VCC

In the case of RS232C, you can select the 9th pin to RI (Input) or VCC (5V Power Supply). If you use the Digital's RS232C Isolation Unit, please select it to VCC.

Device-Specific Settings

Allowable Number of Devices/PLCs

Number	Device Name	Settings
<input type="button" value="1"/>	<input type="text" value="PLC1"/>	<input type="button" value="Settings"/> Series=DL-205/DL-405 Series,Station No=1

##### ◆ Device Setting

To display the setting screen, click  ([Setting]) of the External Device you want to set from [Device-Specific Settings] of [Device/PLC Settings].

Individual Device Settings

PLC1

Series

Please reconfirm all of address settings that you are using if you have changed the series.

Station No

## ■ Settings of External Device

For communication settings, use the rotary switch on the front of the link I/F unit, or the DIP switches on its back. After completing the settings, reboot the External Device to enable them. Please refer to the manual of the External Device for details.

### ◆ Station No. Setting Rotary Switch

Rotary Switch	Settings	Setup Description
x10	0	Station No. of the External Device (tens digit)
x1	1	Station No. of the External Device (ones digit)

#### NOTE

- Enter the station No. set on the Display.

### ◆ Configuration DIP Switch SW4

DIP Switch	Settings	Setup Description
1	ON	Baud rate transmission speed: 19,200bps
2	ON	
3	ON	
4	ON	Parity enable/disable: Enabled (odd)
5	OFF	Self-diagnosis mode: OFF
6	OFF	Response delay time: 0 ms
7	OFF	
8	OFF	

### ◆ Configuration DIP Switch SW5

DIP Switch	Settings	Setup Description
1	OFF	Peer to Peer setting: 1:n mode
2	OFF	Master/Slave setting: Slave
3	OFF	Timeout enable/disable setting: Normal operation mode
4	OFF	Transmission mode: HEX mode


### 3.19 Setting Example 19

#### ■ Settings of GP-Pro EX

##### ◆ Communication Settings

To display the setting screen, select [Device/PLC Settings] from [System setting window] in workspace.

##### ◆ Device Setting

To display the setting screen, click  ([Setting]) of the External Device you want to set from [Device-Specific Settings] of [Device/PLC Settings].

## ■ Settings of External Device

For communication settings, use the rotary switch on the front of the link I/F unit, or the DIP switches on its back. After completing the settings, reboot the External Device to enable them. Please refer to the manual of the External Device for details.

### ◆ Station No. Setting Rotary Switch

Rotary Switch	Settings	Setup Description
x10	0	Station No. of the External Device (tens digit)
x1	1	Station No. of the External Device (ones digit)

#### NOTE

- Enter the station No. set on the Display.

### ◆ Configuration DIP Switch SW4

DIP Switch	Settings	Setup Description
1	ON	Baud rate transmission speed: 19,200bps
2	ON	
3	ON	
4	ON	Parity enable/disable: Enabled (odd)
5	OFF	Self-diagnosis mode: OFF
6	OFF	Response delay time: 0 ms
7	OFF	
8	OFF	

### ◆ Configuration DIP Switch SW5

DIP Switch	Settings	Setup Description
1	OFF	Peer to Peer setting: 1:n mode
2	OFF	Master/Slave setting: Slave
3	OFF	Timeout enable/disable setting: Normal operation mode
4	OFF	Transmission mode: HEX mode




## 3.20 Setting Example 20

### ■ Settings of GP-Pro EX

#### ◆ Communication Settings

To display the setting screen, select [Device/PLC Settings] from [System setting window] in workspace.

#### ◆ Device Setting

To display the setting screen, click  ([Setting]) of the External Device you want to set from [Device-Specific Settings] of [Device/PLC Settings].

## ■ Settings of External Device

For communication settings, use the DIP switches on the CPU unit. To set the station No., use the instruction word programmer (S-01P). After completing the settings, reboot the External Device to enable them. Please refer to the manual of the External Device for details.

### ◆ Communication Setting Switch

DIP Switch	Settings	Setup Description
SW1	Optional	Battery mode: Adjust to the system.
SW2	OFF	CCM station No. setting: Enabled
SW3	ON	Baud rate transmission speed: 19,200bps
SW4	ON	

#### NOTE

- Setting SW2 to ON switches the transmission mode to ASCII mode and thus disables communication. Make sure to set it to OFF and set the CCM station No. and transmission mode.

### ◆ CCM Station No. Setting

- 1 Select Menu 56. Press [Clear], [5], [6], [Menu], and then press the Enter key.
- 2 Enter the CCM station No. Press [0], [1], and then press the Enter key.

#### NOTE

- Enter the station No. set on the Display.

- 3 Set the transmission mode to "HEX", and then press the Enter key.
- 4 Set the parity to "ODD", and then press the Enter key.


## 3.21 Setting Example 21

### ■ Settings of GP-Pro EX

#### ◆ Communication Settings

To display the setting screen, select [Device/PLC Settings] from [System setting window] in workspace.

#### ◆ Device Setting

To display the setting screen, click  ([Setting]) of the External Device you want to set from [Device-Specific Settings] of [Device/PLC Settings].

## ■ Settings of External Device

For communication settings, use the DIP switches on the CPU unit. To set the station No., use the instruction word programmer (S-01P). After completing the settings, reboot the External Device to enable them. Please refer to the manual of the External Device for details.

### ◆ Communication Setting Switch

DIP Switch	Settings	Setup Description
SW1	Optional	Battery mode: Adjust to the system.
SW2	OFF	CCM station No. setting: Enabled
SW3	ON	Baud rate transmission speed: 19,200bps
SW4	ON	

#### NOTE

- Setting SW2 to ON switches the transmission mode to ASCII mode and thus disables communication. Make sure to set it to OFF and set the CCM station No. and transmission mode.

### ◆ CCM Station No. Setting

- 1 Select Menu 56. Press [Clear], [5], [6], [Menu], and then press the Enter key.
- 2 Enter the CCM station No. Press [0], [1], and then press the Enter key.

#### NOTE

- Enter the station No. set on the Display.

- 3 Set the transmission mode to "HEX", and then press the Enter key.
- 4 Set the parity to "ODD", and then press the Enter key.


## 3.22 Setting Example 22

### ■ Settings of GP-Pro EX

#### ◆ Communication Settings

To display the setting screen, select [Device/PLC Settings] from [System setting window] in workspace.

#### ◆ Device Setting

To display the setting screen, click  ([Setting]) of the External Device you want to set from [Device-Specific Settings] of [Device/PLC Settings].

## ■ Settings of External Device

For communication settings, use the DIP switches on the side of the link I/F unit. After completing the settings, reboot the External Device to enable them. Please refer to the manual of the External Device for details.

### ◆ Configuration DIP Switch SW1

DIP Switch	Settings	Setup Description
1	ON	Baud rate transmission speed: 19,200bps
2	ON	
3	OFF	Parity enable/disable: Disabled
4	ON	Self-diagnosis mode: OFF
5	OFF	Turnaround delay: None
6	OFF	Power-on mode: Adjust to the system.
7	OFF	Always OFF
8	OFF	Transmission mode: HEX mode

### ◆ Configuration DIP Switch SW2

DIP Switch	Settings	Setup Description
1	ON	Child station No.: 1
2	OFF	
3	OFF	
4	OFF	
5	OFF	
6	OFF	
7	OFF	
8	OFF	Always OFF


### 3.23 Setting Example 23

#### ■ Settings of GP-Pro EX

##### ◆ Communication Settings

To display the setting screen, select [Device/PLC Settings] from [System setting window] in workspace.

##### ◆ Device Setting

To display the setting screen, click  ([Setting]) of the External Device you want to set from [Device-Specific Settings] of [Device/PLC Settings].

## ■ Settings of External Device

For communication settings, use the instruction word programmer (Z-20JP). After completing the settings, reboot the External Device to enable them. Please refer to the manual of the External Device for details.

- 1 Select Menu 56. Press [Clear], [5], [6], [Menu], and then press the Enter key.
- 2 Set the protocol to "CCM2", and then press the Enter key.
- 3 Enter the CCM station No. Press [0], [1], and then press the Enter key.

---

**NOTE**

- Enter the station No. set on the Display.
- 

- 4 Set the transmission mode to "HEX", and then press the Enter key.
- 5 Set the transmission speed to "19200", and then press the Enter key.
- 6 Set the stop bit to "1", and then press the Enter key.
- 7 Set the parity to "ODD", and then press the Enter key.




## 3.24 Setting Example 24

### ■ Settings of GP-Pro EX

#### ◆ Communication Settings

To display the setting screen, select [Device/PLC Settings] from [System setting window] in workspace.

#### ◆ Device Setting

To display the setting screen, click  ([Setting]) of the External Device you want to set from [Device-Specific Settings] of [Device/PLC Settings].

### ■ Settings of External Device

The communication device does not require any communication settings.

The baud rate transmission speed and the station address are fixed.

The parity, data length, and stop bit also cannot be changed.

## 3.25 Setting Example 25

### ■ Settings of GP-Pro EX

#### ◆ Communication Settings

To display the setting screen, select [Device/PLC Settings] from [System setting window] in workspace.

Device/PLC 1

Summary [Change Device/PLC](#)

Maker  Series  Port

Text Data Mode  [Change](#)

Communication Settings

SID Type  RS232C  RS422/485(2wire)  RS422/485(4wire)

Speed

Data Length  7  8

Parity  NONE  EVEN  ODD

Stop Bit  1  2

Flow Control  NONE  ER(DTR/CTS)  XON/XOFF

Timeout  (sec)

Retry

Wait To Send  (ms)

RI / VCC  RI  VCC

In the case of RS232C, you can select the 9th pin to RI (Input) or VCC (5V Power Supply). If you use the Digital's RS232C Isolation Unit, please select it to VCC.

Device-Specific Settings

Allowable Number of Devices/PLCs 16

Number	Device Name	Settings
<input type="button" value="1"/>	<input type="text" value="PLC1"/>	<input type="button" value="Settings"/> Series=KOSTAC SG/SU/SZ Series, Station No=1

#### ◆ Device Setting

To display the setting screen, click  ([Setting]) of the External Device you want to set from [Device-Specific Settings] of [Device/PLC Settings].

Individual Device Settings

PLC1

Series

Please reconfirm all of address settings that you are using if you have changed the series.

Station No

## ■ Settings of External Device

Use the ladder software (DirectSOFT32 programming version 4.0) for communication settings. After completing the settings, reboot the External Device to enable them. Please refer to the manual of the External Device for details.

- 1 Start the ladder software (DirectSOFT32) and go online with the External Device.
- 2 From the [PLC] menu, select [Settings] - [General-purpose port settings].
- 3 In the [Communication port settings] dialog box, configure the following communication settings.

Item	Settings
Port	Port 2
Protocol	CCM Net (DirectNET)
Timeout	500 ms
RTS on Delay Time	20 ms
Station No.	1
Speed	19,200bps
Stop Bit	1
Parity	Odd
Data Format	Hex

- 4 When the settings are complete, click [Transfer] to transfer them to the External Device.

## 3.26 Setting Example 26

### ■ Settings of GP-Pro EX

#### ◆ Communication Settings

To display the setting screen, select [Device/PLC Settings] from [System setting window] in workspace.

Device/PLC 1

Summary [Change Device/PLC](#)

Maker  Series  Port

Text Data Mode  [Change](#)

Communication Settings

SID Type  RS232C  RS422/485(2wire)  RS422/485(4wire)

Speed

Data Length  7  8

Parity  NONE  EVEN  ODD

Stop Bit  1  2

Flow Control  NONE  ER(DTR/CTS)  XON/XOFF

Timeout  (sec)

Retry

Wait To Send  (ms)

RI / VCC  RI  VCC

In the case of RS232C, you can select the 9th pin to RI (Input) or VCC (5V Power Supply). If you use the Digital's RS232C Isolation Unit, please select it to VCC.

Device-Specific Settings

Allowable Number of Devices/PLCs 16

Number	Device Name	Settings
<input type="button" value="1"/>	<input type="text" value="PLC1"/>	<input type="button" value="Settings"/> Series=KOSTAC SG/SU/SZ Series,Station No=1

#### ◆ Device Setting

To display the setting screen, click  ([Setting]) of the External Device you want to set from [Device-Specific Settings] of [Device/PLC Settings].

Individual Device Settings

PLC1

Series

Please reconfirm all of address settings that you are using if you have changed the series.

Station No

## ■ Settings of External Device

Use the ladder software (DirectSOFT32 programming version 4.0) for communication settings. After completing the settings, reboot the External Device to enable them. Please refer to the manual of the External Device for details.

- 1 Start the ladder software (DirectSOFT32) and go online with the External Device.
- 2 From the [PLC] menu, select [Settings] - [General-purpose port settings].
- 3 In the [Communication port settings] dialog box, configure the following communication settings.

Item	Settings
Port	Port 2
Protocol	CCM Net (DirectNET)
Timeout	500 ms
RTS on Delay Time	20 ms
Station No.	1
Speed	19,200bps
Stop Bit	1
Parity	Odd
Data Format	Hex

- 4 When the settings are complete, click [Transfer] to transfer them to the External Device.

## 4 Setup Items

Set the communication settings of the Display with GP-Pro Ex or in off-line mode of the Display.


The setting of each parameter must be identical to that of the External Device.

 "3 Example of Communication Setting" (page 11)

### 4.1 Setup Items in GP-Pro EX

#### ■ Communication Settings

To display the setting screen, select [Device/PLC Settings] from [System setting window] in workspace.

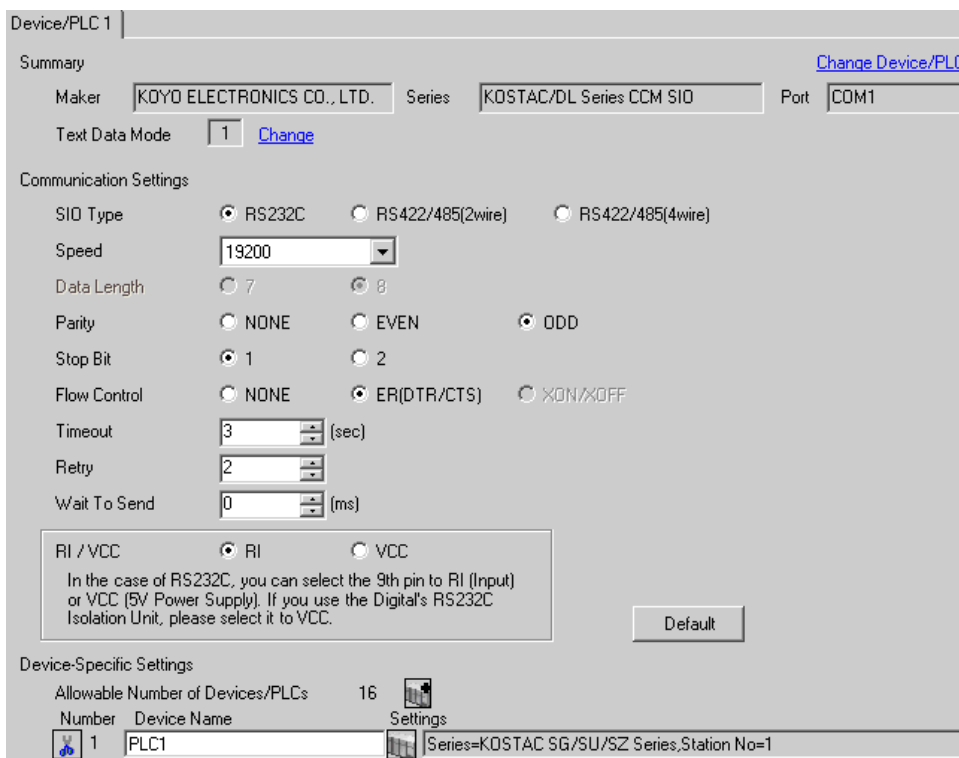

Device/PLC 1

Summary [Change Device/PLC](#)

Maker  Series  Port

Text Data Mode  [Change](#)

Communication Settings

SIO Type  RS232C  RS422/485(2wire)  RS422/485(4wire)

Speed

Data Length  7  8

Parity  NONE  EVEN  ODD

Stop Bit  1  2

Flow Control  NONE  ER(DTR/CTS)  XON/XOFF

Timeout  (sec)


Retry

Wait To Send  (ms)

RI / VCC  RI  VCC

In the case of RS232C, you can select the 9th pin to RI (Input) or VCC (5V Power Supply). If you use the Digital's RS232C Isolation Unit, please select it to VCC.

Device-Specific Settings

Allowable Number of Devices/PLCs  


Number	Device Name	Settings
<input type="text" value="1"/>	<input type="text" value="PLC1"/>	<input type="text" value="Series=KOSTAC SG/SU/SZ Series,Station No=1"/>


Setup Items	Setup Description
SIO Type	Select the SIO type for communicating with the External Device.
Speed	Select the communication speed between the External Device and the Display.
Data Length	Select data length.
Parity	Select how to check parity.
Stop Bit	Select stop bit length.
Flow Control	Select the communication control method to prevent overflow of transmission and reception data.
Timeout	Use an integer from "1 to 127" to enter the time (s) for which the Display waits for the response from the External Device.


Continued to next page.

Setup Items	Setup Description
Retry	In case of no response from the External Device, use an integer from "0 to 255" to enter how many times the Display retransmits the command.
Wait To Send	Use an integer from "0 to 255" to enter the standby time (ms) from when the Display receives packets until it transmits the next command.
RI/VCC	You can switch RI/VCC of the 9th pin when you select RS232C for the SIO type. To connect to the IPC, you need to use the IPC selector switch to change RI/5V. Please refer to the manual of the IPC for details.

## ■ Device Setting

To display the setting screen, click  ([Setting]) of the External Device you want to set from [Device-Specific Settings ] of [Device/PLC Settings ].

To connect multiple External Devices, click  from [Device-Specific Settings] of [Device/PLC Settings] to add External Devices.

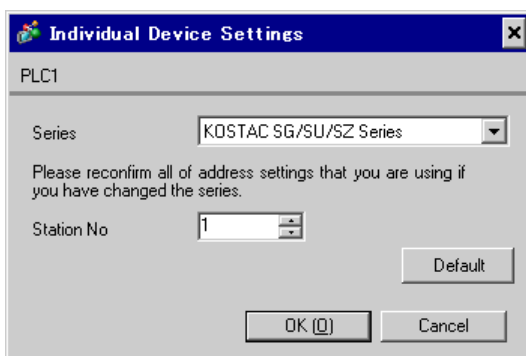

Setup Items	Setup Description
Series	Select the series of the External Device.
Station No.	Enter the station No. of the External Device, from "1 to 90".

## 4.2 Settings in Off-Line Mode

**NOTE**

- Please refer to the Maintenance/Troubleshooting manual for more information on how to enter off-line mode or about the operation.

Cf. Maintenance/Troubleshooting Manual "2.2 Off-line Mode"

### ■ Communication Settings

To display the setting screen, touch [Device/PLC Settings] from [Peripheral Equipment Settings] in off-line mode. Touch the External Device you want to set from the list that appears.

Comm.	Device	Option		
KOSTAC/DL Series CCM SIO		[COM1]	Page 1/1	
SIO Type	RS232C			
Speed	19200			
Data Length	8			
Parity	<input type="radio"/> NONE <input type="radio"/> EVEN <input checked="" type="radio"/> ODD			
Stop Bit	<input checked="" type="radio"/> 1 <input type="radio"/> 2			
Flow Control	ER(DTR/CTS)			
Timeout(s)		3	▼	▲
Retry		2	▼	▲
Wait To Send(ms)		0	▼	▲
Exit		Back		2007/06/14 16:00:19

Setup Items	Setup Description
SIO Type	Select the SIO type for communicating with the External Device. <b>IMPORTANT</b> In the communication settings, confirm the serial interface specifications of the Display and set [SIO Type] correctly. If you select an SIO type that the serial interface does not support, we cannot guarantee the operation. Please refer to the manual of the Display for more details on the serial interface specifications.
Speed	Select the communication speed between the External Device and the Display.
Data Length	Select data length.
Parity	Select how to check parity.
Stop Bit	Select stop bit length.



Setup Items	Setup Description
Flow Control	Select the communication control method to prevent overflow of transmission and reception data.
Timeout	Use an integer from "1 to 127" to enter the time (s) for which the Display waits for the response from the External Device.
Retry	In case of no response from the External Device, use an integer from "0 to 255" to enter how many times the Display retransmits the command.
Wait To Send	Use an integer from "0 to 255" to enter the standby time (ms) from when the Display receives packets until it transmits the next command.

## ■ Device Setting

To display the setting screen, touch [Device/PLC Settings] from [Peripheral Equipment Settings]. Touch the External Device you want to set from the list that appears, and touch [Device Settings].

Comm.	Device	Option		
KOSTAC/DL Series CCM SIO		[COM1]	Page 1/1	
Device/PLC Name		PLC1		
Series		KOSTAC SG/SU/SZ Series		
Station No.		1		
Exit		Back		2007/06/14 16:00:27

Setup Items	Setup Description
Device/PLC Name	Select the External Device to set. Device name is the title of the External Device set with GP-Pro EX. (Initial value [PLC1])
Series	Displays the series of the External Device.
Station No.	Enter the station No. of the External Device, from "1 to 90".

## ■ Option Settings

To display the setting screen, touch [Device/PLC Settings] from [Peripheral Equipment Settings]. Touch the External Device you want to set from the list that appears, and touch [Option].

Comm.	Device	Option		
KOSTAC/DL Series CCM SIO			[COM1]	Page 1/1
RI / VCC <input checked="" type="radio"/> RI <input type="radio"/> VCC In the case of RS232C, you can select the 9th pin to RI(Input) or VCC(5V Power Supply). If you use the Digital's RS232C Isolation Unit, please select it to VCC.				
	Exit		Back	2007/06/14 16:00:37

Setup Items	Setup Description
RI/VCC	You can switch RI/VCC of the 9th pin when you select RS232C for the SIO type. To connect to the IPC, you need to use the IPC selector switch to change RI/5V. Please refer to the manual of the IPC for details.

## 5 Cable Diagram

The following cable diagram may be different from the one recommended by KOYO ELECTRONICS CO., LTD. Please be assured, however, there is no operational problem in applying the cable diagram shown in this manual.


- The FG pin on the External Device must be D-class grounded. Please refer to the manual of the External Device for details.
- The SG and FG are connected inside the Display. If you connect the External Device to the SG, do not form any short-circuit loop in the system design.
- If the communication is not stable due to noise or other factors, connect an isolation unit.

Cable Diagram 1

Display (Connection Port)	Cable	Remarks
GP (COM1) IPC*1 PC/AT	Your own cable	Cable length: 15m or less

\*1 Available only with the COM ports that support RS-232C.


- ☞ ■ COM Port of IPC (page 8)

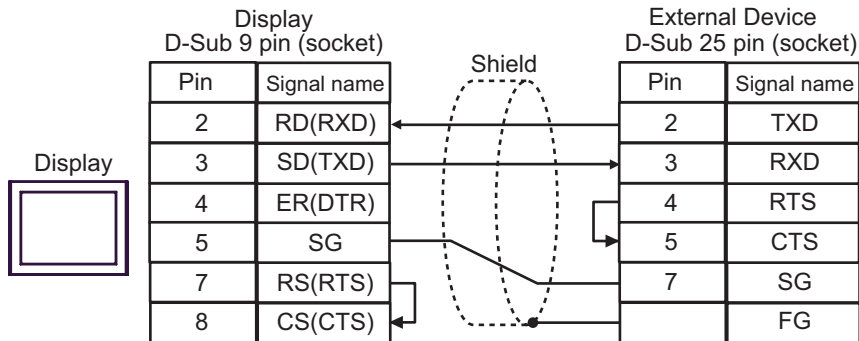

Cable Diagram 2


Display (Connection Port)	Cable		Remarks
GP* <sup>1</sup> (COM1) AGP3302B (COM2) IPC* <sup>2</sup>	A	COM port conversion adapter by Digital Electronics Corp. CA3-ADPCOM-01 + Connector terminal block conversion adapter by Digital Electronics Corp. CA3-ADPTRM-01 + Your own cable	Cable length: 600m or less
	B	Your own cable	
GP* <sup>1</sup> (COM2)	C	Online adapter by Digital Electronics Corp. CA4-ADPONL-01 + Connector terminal block conversion adapter by Digital Electronics Corp. CA3-ADPTRM-01 + Your own cable	
	D	Online adapter by Digital Electronics Corp. CA4-ADPONL-01 + Your own cable	

\*1 All GP models except AGP-3302B

\*2 Available only with the COM ports that support RS-422/485 (4wire).  
 ■ COM Port of IPC (page 8)

A. When using the COM port conversion adapter (CA3-ADPCOM-01), the connector terminal block conversion adapter (CA3-ADPTRM-01) by Digital Electronics Corp., and your own cable


- 1:1 Connection

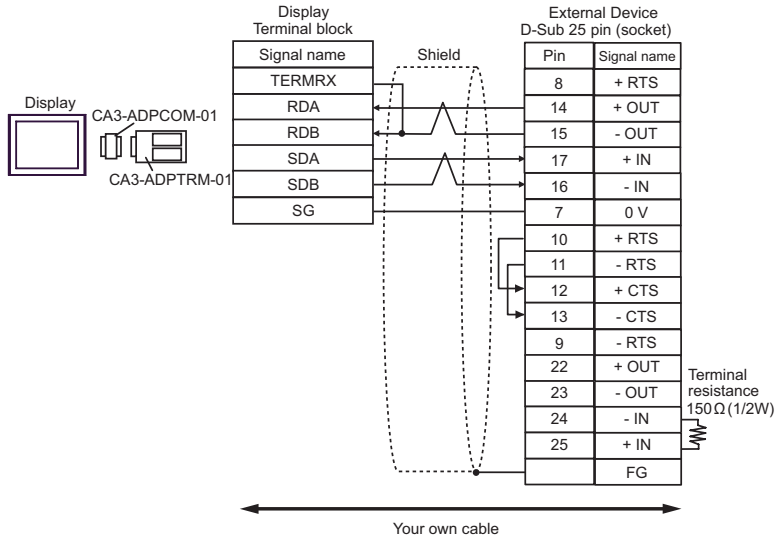

**NOTE**

- Connect a 150Ω termination resistor to the +IN and -IN that are not used.

- 1:n Connection

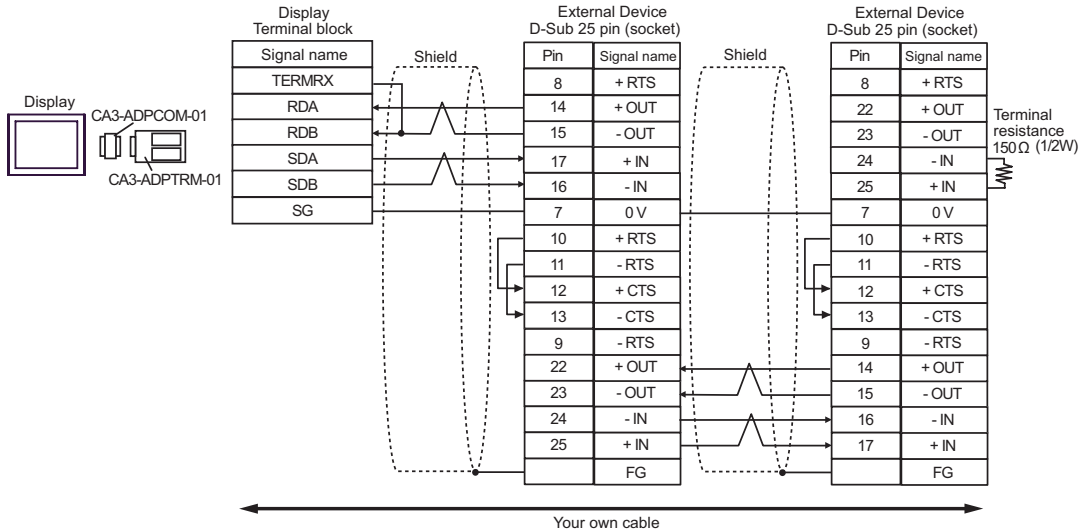


**NOTE**

- Connect a 150Ω termination resistor to the +IN and -IN that are not used.


B. When using your own cable

- 1:1 Connection

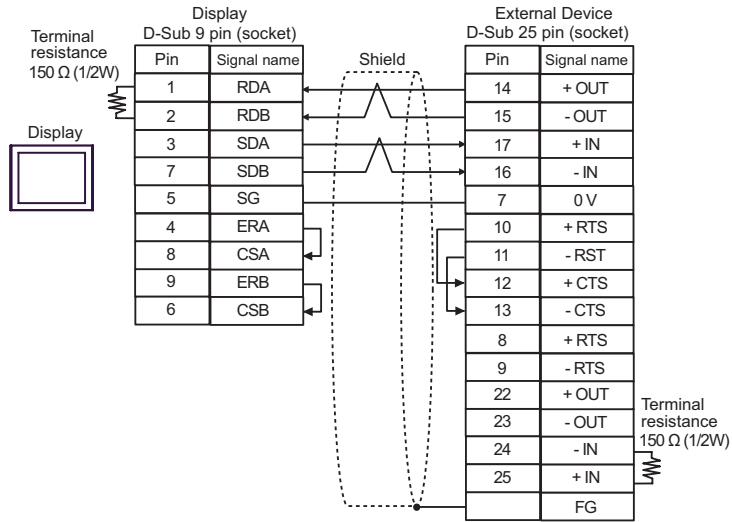

**NOTE** • Connect a 150Ω termination resistor to the +IN and -IN that are not used.


- 1:n Connection

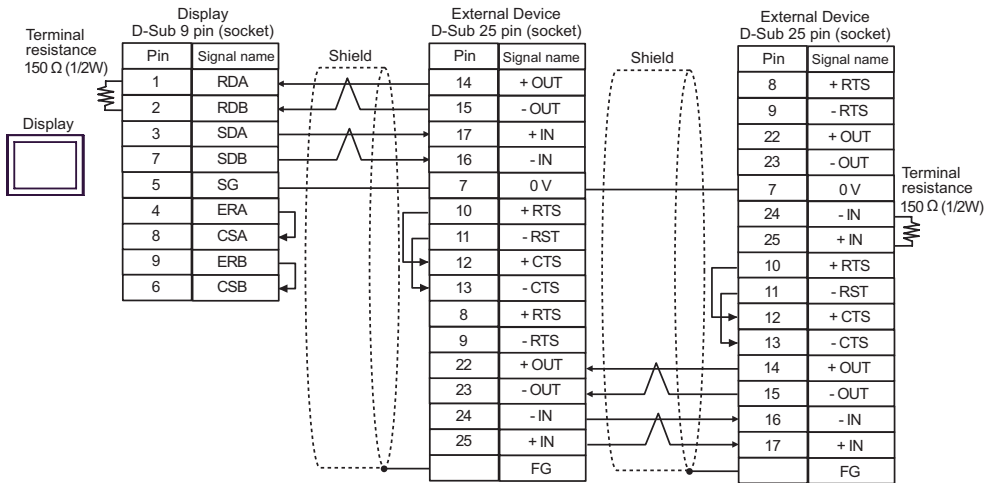

**NOTE** • Connect a 150Ω termination resistor to the +IN and -IN that are not used.


C. When using the online adapter (CA4-ADPONL-01), the connector terminal block conversion adapter (CA3-ADPTRM-01) by Digital Electronics Corp., and your own cable

- 1:1 Connection

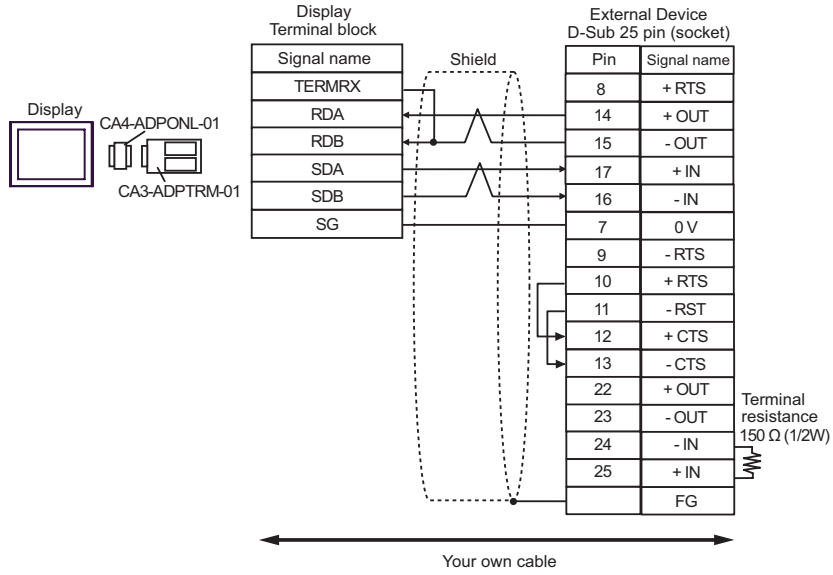

**NOTE** • Connect a 150Ω termination resistor to the +IN and -IN that are not used.


- 1:n Connection

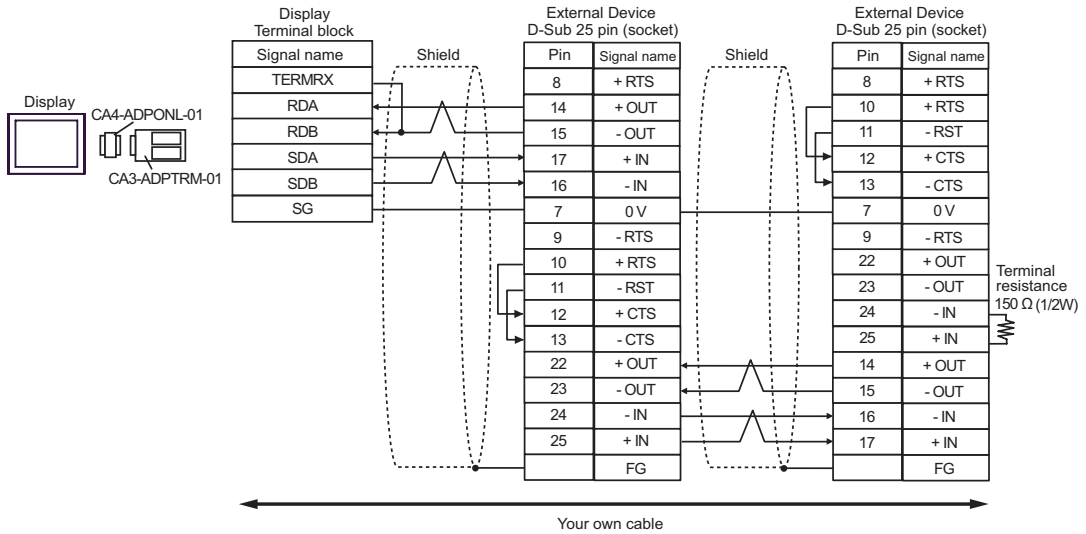

**NOTE** • Connect a 150Ω termination resistor to the +IN and -IN that are not used.


D. When using the online adapter (CA4-ADPONL-01) by Digital Electronics Corp. and your own cable

- 1:1 Connection

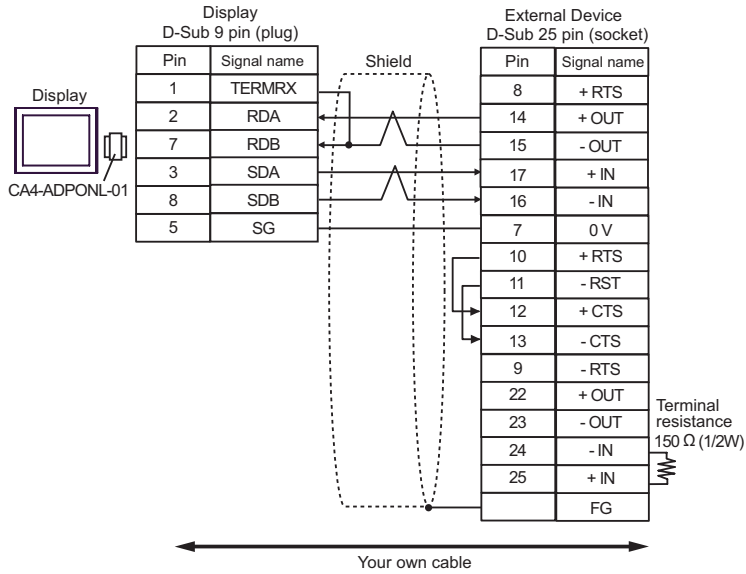

**NOTE** • Connect a 150Ω termination resistor to the +IN and -IN that are not used.

- 1:n Connection

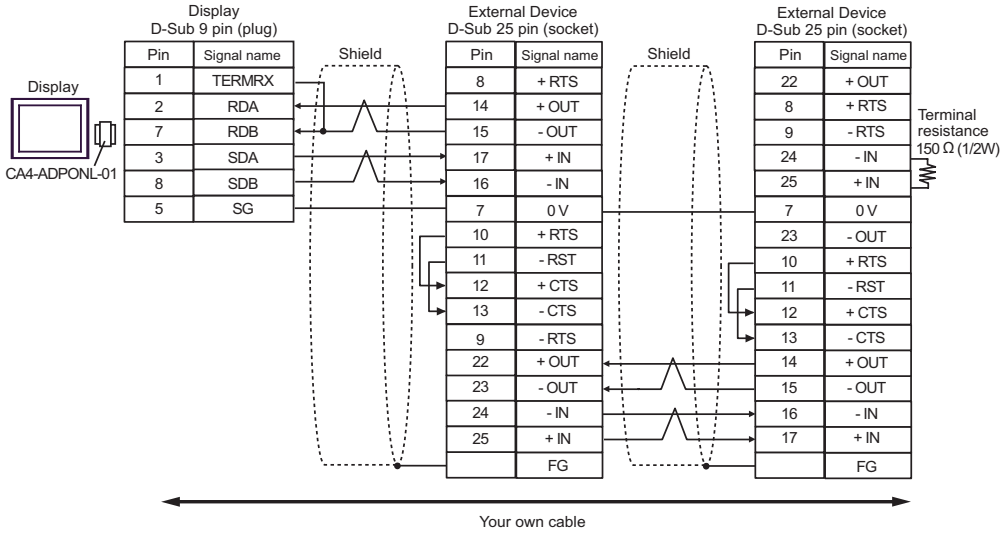


**NOTE** • Connect a 150Ω termination resistor to the +IN and -IN that are not used.




Cable Diagram 3

Display (Connection Port)	Cable		Remarks
GP*1 (COM1) AGP3302B (COM2) IPC*2	A	COM port conversion adapter by Digital Electronics Corp. CA3-ADPCOM-01 + Connector terminal block conversion adapter by Digital Electronics Corp. CA3-ADPTRM-01 + Your own cable	Cable length: 600m or less
	B	Your own cable	
GP (COM2)	C	Online adapter by Digital Electronics Corp. CA4-ADPONL-01 + Connector terminal block conversion adapter by Digital Electronics Corp. CA3-ADPTRM-01 + Your own cable	
	D	Online adapter by Digital Electronics Corp. CA4-ADPONL-01 + Your own cable	

\*1 All GP models except AGP-3302B


\*2 Available only with the COM ports that support RS-422/485 (4wire).  
 ■ COM Port of IPC (page 8)

A. When using the COM port conversion adapter (CA3-ADPCOM-01), the connector terminal block conversion adapter (CA3-ADPTRM-01) by Digital Electronics Corp., and your own cable

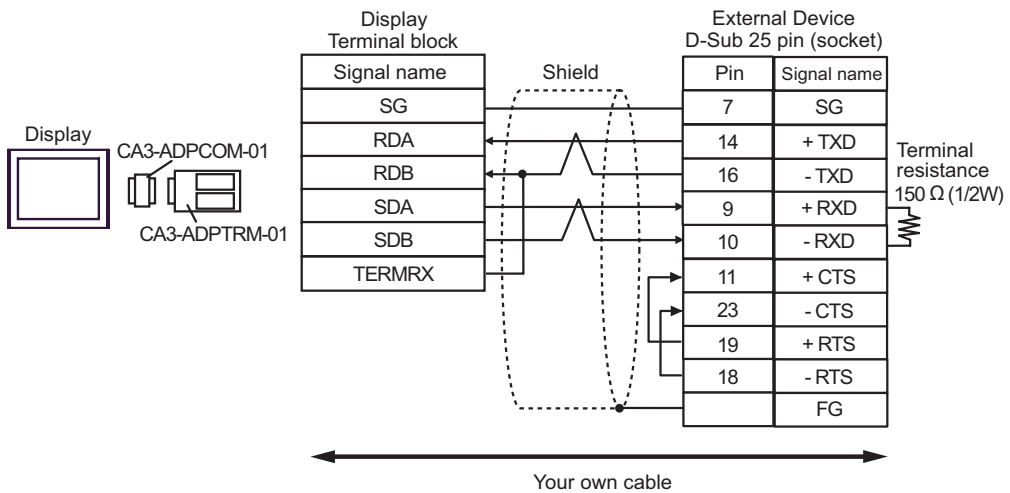


**NOTE** • Connect a 150Ω termination resistor to the +RXD and -RXD.

B. When using your own cable

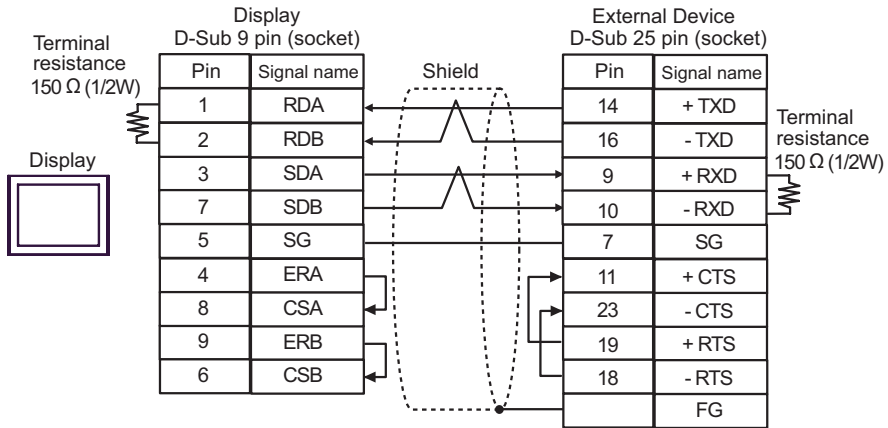


**NOTE** • Connect a 150Ω termination resistor to the +RXD and -RXD.

C. When using the online adapter (CA4-ADPONL-01), the connector terminal block conversion adapter (CA3-ADPTRM-01) by Digital Electronics Corp., and your own cable

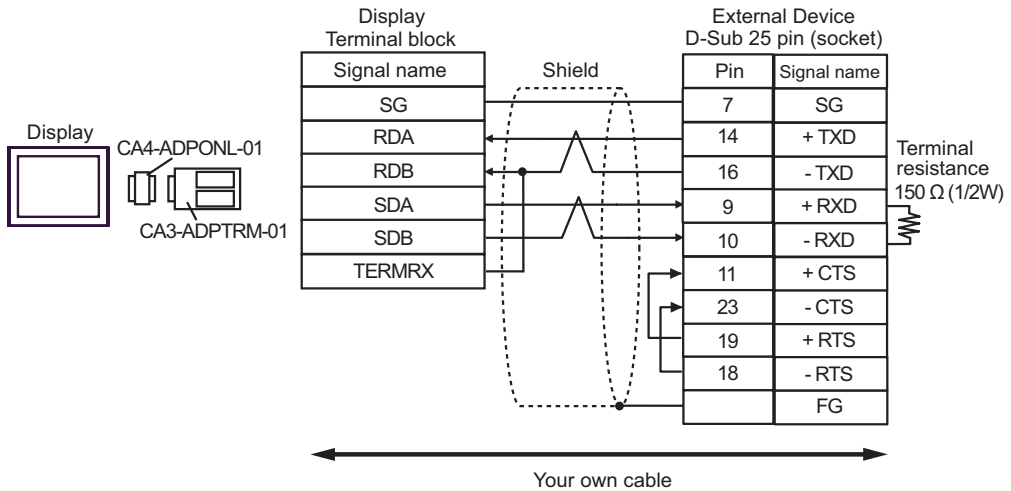

**NOTE** • Connect a 150Ω termination resistor to the +RXD and -RXD.

D. When using the online adapter (CA4-ADPONL-01) by Digital Electronics Corp. and your own cable

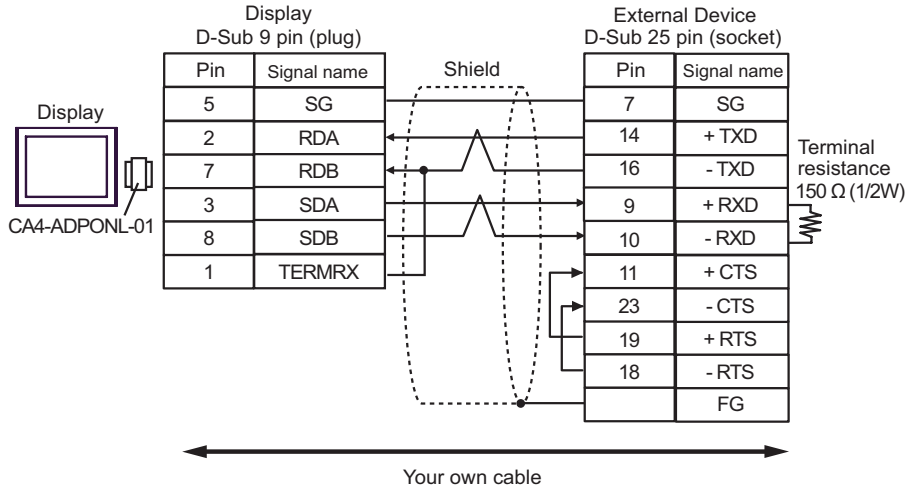
**NOTE**


- Connect a 150Ω termination resistor to the +RXD and -RXD.

Cable Diagram 4

Display (Connection Port)	Cable	Remarks
GP (COM1) IPC*1 PC/AT	Your own cable	Cable length: 15m or less

\*1 Available only with the COM ports that support RS-232C.


 ■ COM Port of IPC (page 8)

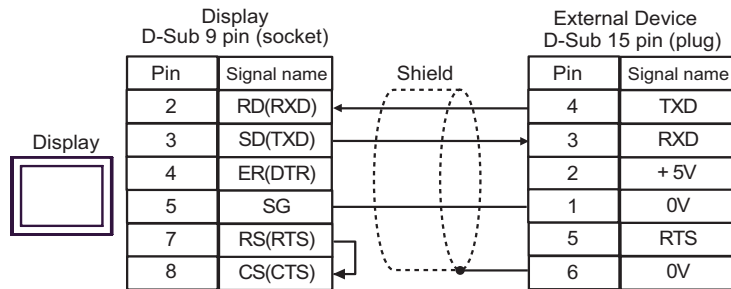


Cable Diagram 5

Display (Connection Port)	Cable	Remarks
GP (COM1) IPC*1 PC/AT	Your own cable	Cable length: 3m or less

\*1 Available only with the COM ports that support RS-232C.


 ■ COM Port of IPC (page 8)

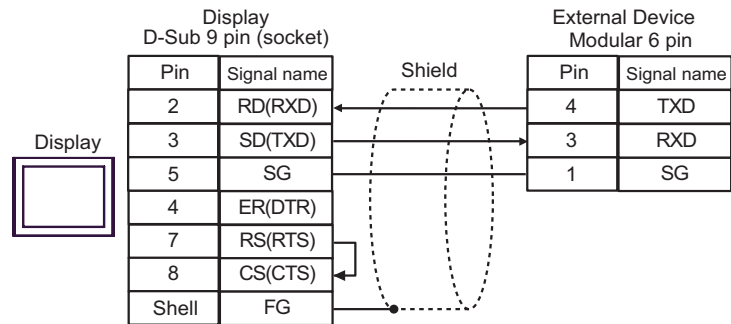


Cable Diagram 6

Display (Connection Port)	Cable		Remarks
GP*1 (COM1) AGP-3302B (COM2) IPC*2	A	COM port conversion adapter by Digital Electronics Corp. CA3-ADPCOM-01 + Connector terminal block conversion adapter by Digital Electronics Corp. CA3-ADPTRM-01 + Your own cable	Cable length: 600m or less
	B	Your own cable	
GP (COM2)	C	Online adapter by Digital Electronics Corp. CA4-ADPONL-01 + Connector terminal block conversion adapter by Digital Electronics Corp. CA3-ADPTRM-01 + Your own cable	
	D	Online adapter by Digital Electronics Corp. CA4-ADPONL-01 + Your own cable	

\*1 All GP models except AGP-3302B


\*2 Available only with the COM ports that support RS-422/485 (4wire).  
 ■ COM Port of IPC (page 8)

A. When using the COM port conversion adapter (CA3-ADPCOM-01), the connector terminal block conversion adapter (CA3-ADPTRM-01) by Digital Electronics Corp., and your own cable

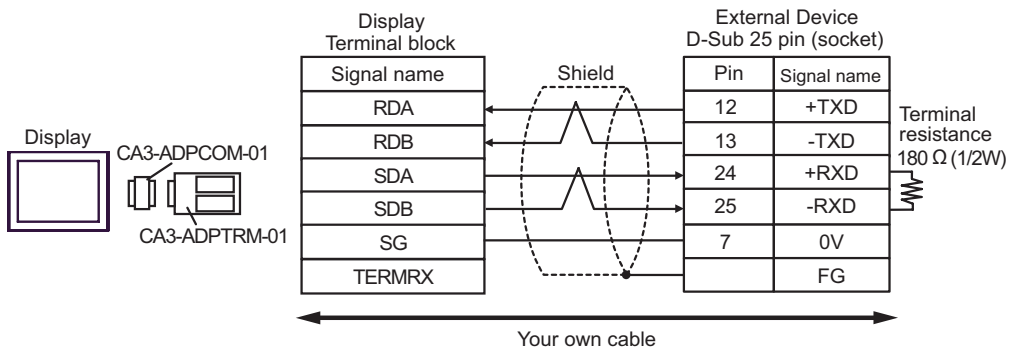


**NOTE** • Connect a 180Ω termination resistor to the +RXD and -RXD.

B. When using your own cable

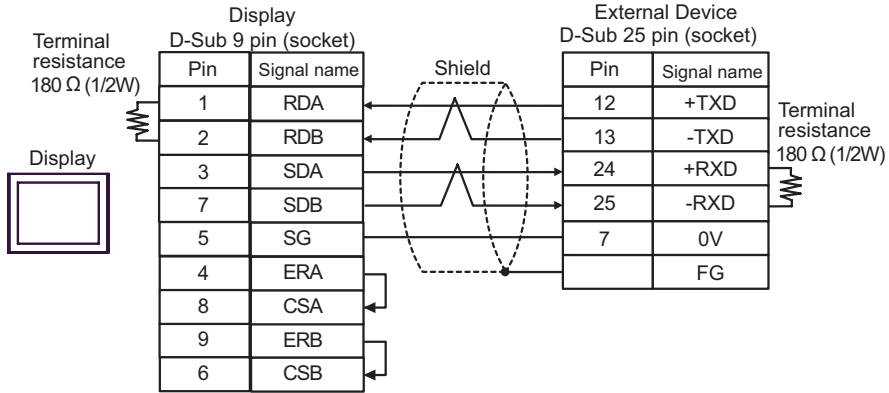


**NOTE** • Connect a 180Ω termination resistor to the +RXD and -RXD.

C. When using the online adapter (CA4-ADPONL-01), the connector terminal block conversion adapter (CA3-ADPTRM-01) by Digital Electronics Corp., and your own cable

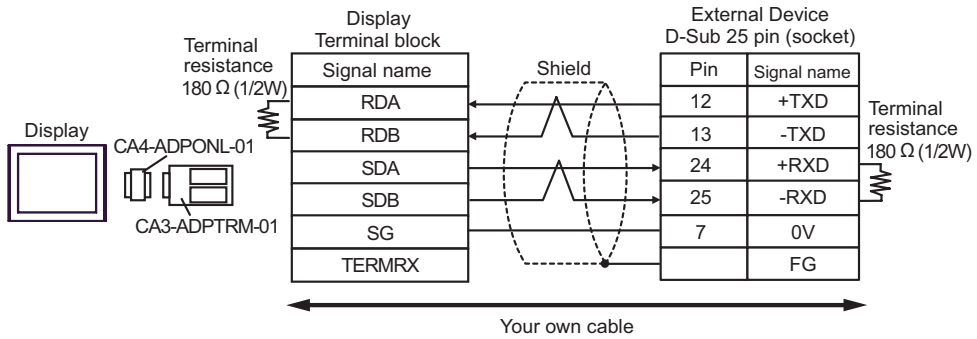

**NOTE** • Connect a 180Ω termination resistor to the +RXD and -RXD.

D. When using the online adapter (CA4-ADPONL-01) by Digital Electronics Corp. and your own cable

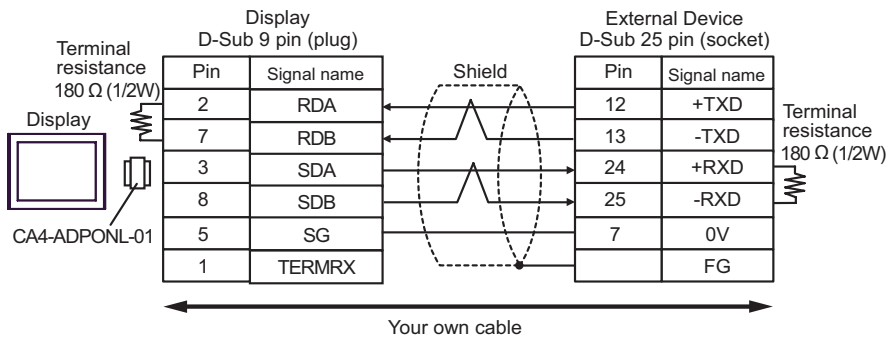


**NOTE** • Connect a 180Ω termination resistor to the +RXD and -RXD.


Cable Diagram 7

Display (Connection Port)	Cable		Remarks
GP*1 (COM1) AGP-3302B (COM2) IPC*2	A	COM port conversion adapter by Digital Electronics Corp. CA3-ADPCOM-01 + Connector terminal block conversion adapter by Digital Electronics Corp. CA3-ADPTRM-01 + Your own cable	Cable length: 600m or less
	B	Your own cable	
GP (COM2)	C	Online adapter by Digital Electronics Corp. CA4-ADPONL-01 + Connector terminal block conversion adapter by Digital Electronics Corp. CA3-ADPTRM-01 + Your own cable	
	D	Online adapter by Digital Electronics Corp. CA4-ADPONL-01 + Your own cable	

\*1 All GP models except AGP-3302B

\*2 Available only with the COM ports that support RS-422/485 (4wire).  
 ■ COM Port of IPC (page 8)


A. When using the COM port conversion adapter (CA3-ADPCOM-01), the connector terminal block conversion adapter (CA3-ADPTRM-01) by Digital Electronics Corp., and your own cable

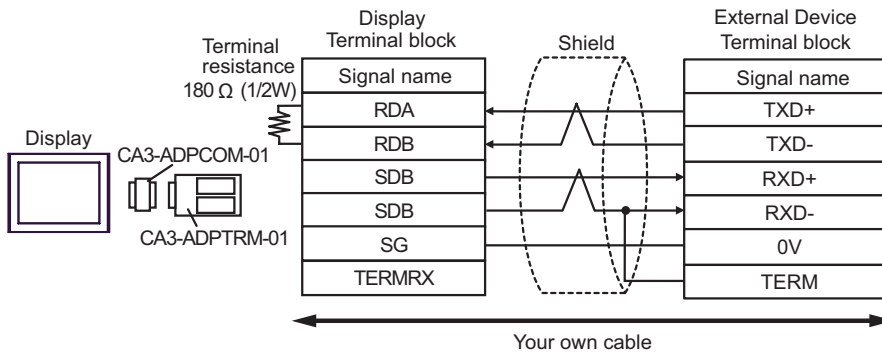

**NOTE**


- Connect a 180Ω termination resistor to the +RXD and -RXD.

B. When using your own cable

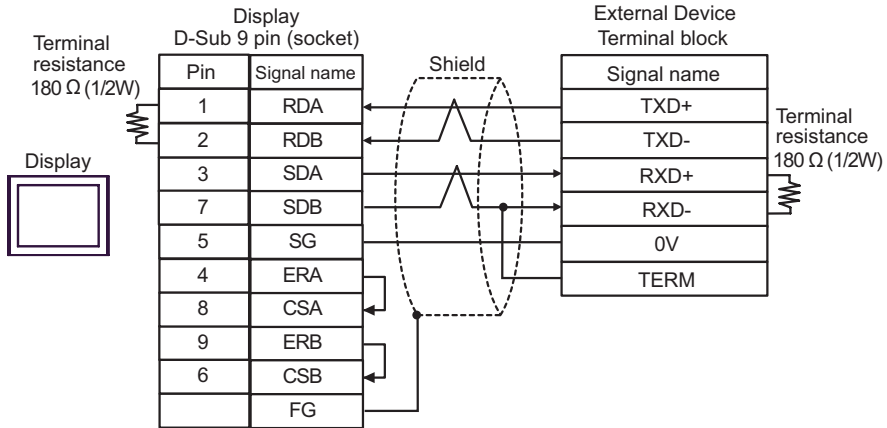


**NOTE** • Connect a 180Ω termination resistor to the +RXD and -RXD.

C. When using the online adapter (CA4-ADPONL-01), the connector terminal block conversion adapter (CA3-ADPTRM-01) by Digital Electronics Corp., and your own cable

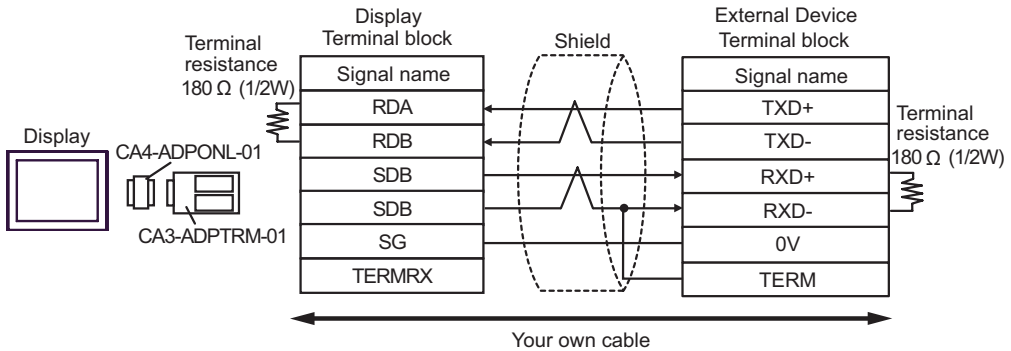

**NOTE** • Connect a 180Ω termination resistor to the +RXD and -RXD.

D. When using the online adapter (CA4-ADPONL-01) by Digital Electronics Corp. and your own cable

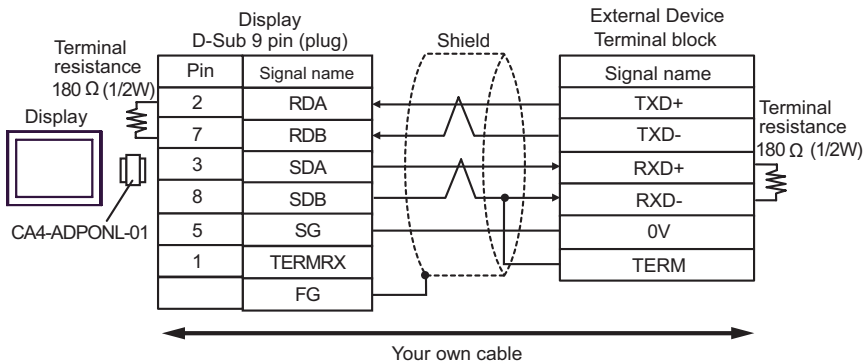

**NOTE** • Connect a 180Ω termination resistor to the +RXD and -RXD.




Cable Diagram 8

Display (Connection Port)	Cable	Remarks
GP (COM1) IPC*1 PC/AT	Your own cable	Cable length: 15m or less

\*1 Available only with the COM ports that support RS-232C.

☞ ■ COM Port of IPC (page 8)

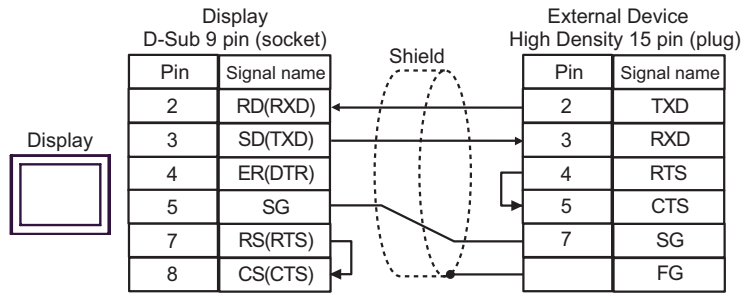


Cable Diagram 9


Display (Connection Port)	Cable		Remarks
GP*1 (COM1) AGP-3302B (COM2) IPC*2	A	COM port conversion adapter by Digital Electronics Corp. CA3-ADPCOM-01 + Connector terminal block conversion adapter by Digital Electronics Corp. CA3-ADPTRM-01 + Your own cable	Cable length: 600m or less
	B	Your own cable	
GP (COM2)	C	Online adapter by Digital Electronics Corp. CA4-ADPONL-01 + Connector terminal block conversion adapter by Digital Electronics Corp. CA3-ADPTRM-01 + Your own cable	
	D	Online adapter by Digital Electronics Corp. CA4-ADPONL-01 + Your own cable	

\*1 All GP models except AGP-3302B

\*2 Available only with the COM ports that support RS-422/485 (4wire).

 ■ COM Port of IPC (page 8)


A. When using the COM port conversion adapter (CA3-ADPCOM-01), the connector terminal block conversion adapter (CA3-ADPTRM-01) by Digital Electronics Corp., and your own cable

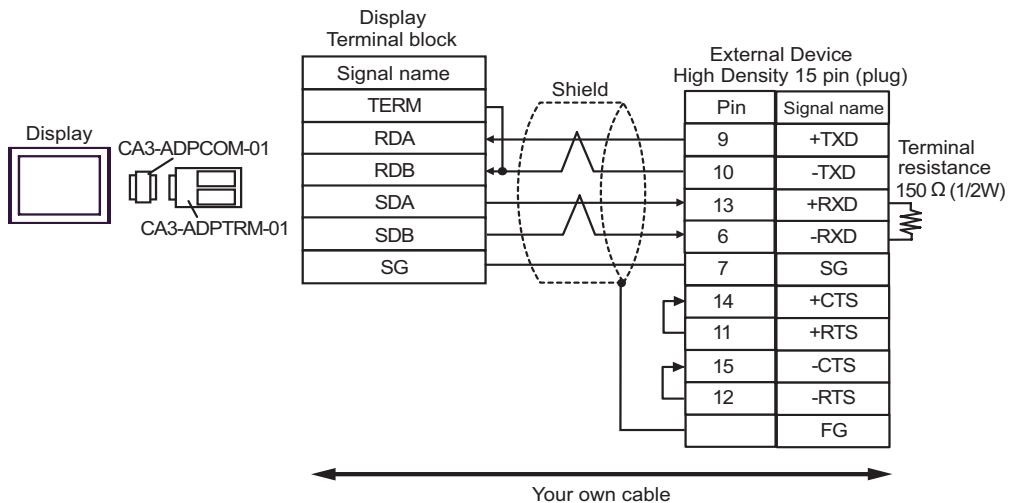

**NOTE**


- Connect a 150Ω termination resistor to the +RXD and -RXD.

B. When using your own cable

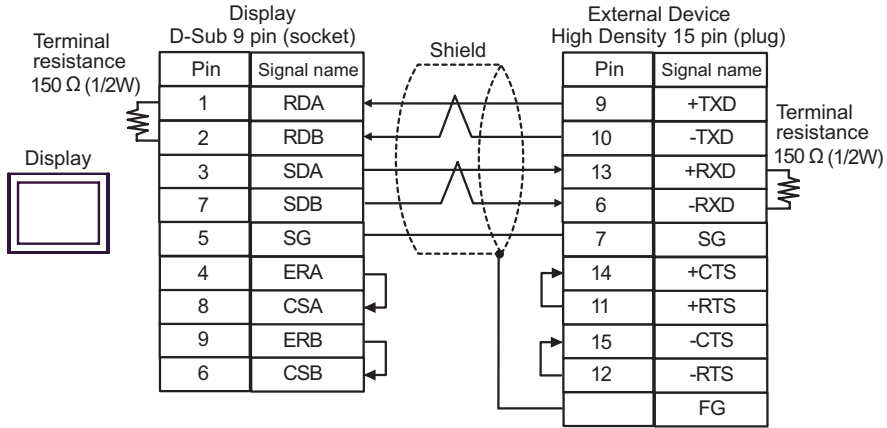


**NOTE** • Connect a 150Ω termination resistor to the +RXD and -RXD.

C. When using the online adapter (CA4-ADPONL-01), the connector terminal block conversion adapter (CA3-ADPTRM-01) by Digital Electronics Corp., and your own cable

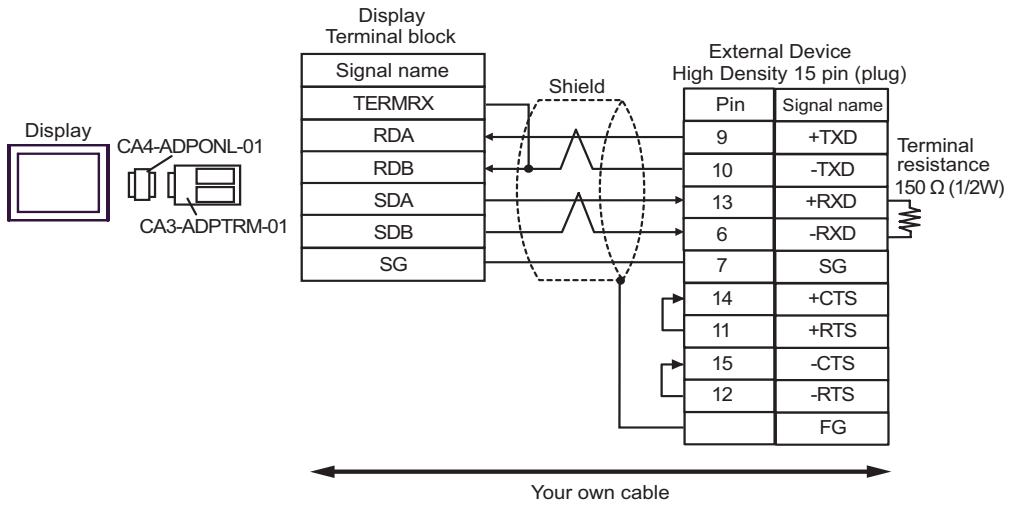

**NOTE** • Connect a 150Ω termination resistor to the +RXD and -RXD.

D. When using the online adapter (CA4-ADPONL-01) by Digital Electronics Corp. and your own cable

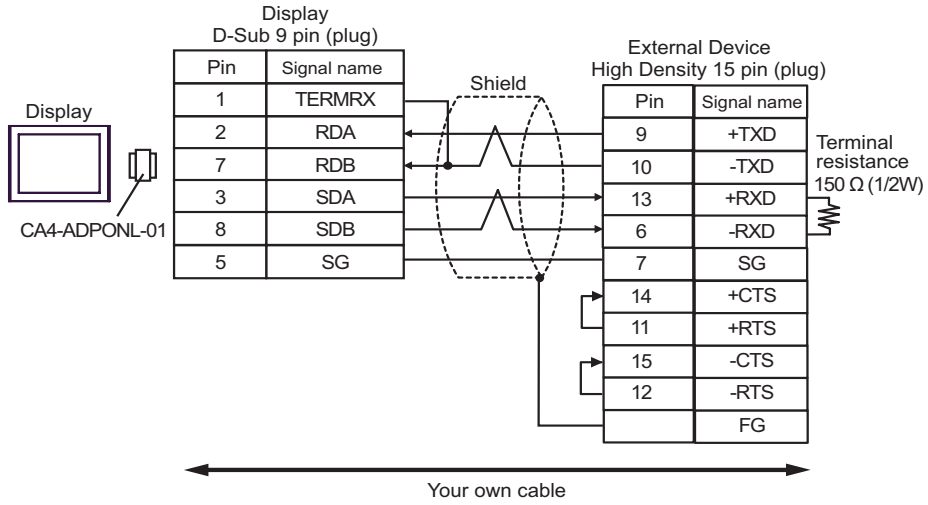**NOTE**

- Connect a 150Ω termination resistor to the +RXD and -RXD.

## 6 Supported Device

The following table shows the range of supported device addresses. Available type and range of device may vary depending on the CPU. Be sure to check them in each CPU manual before use.

### ■ KOSTAC SG Series

     : This address can be specified as system data area.

Device	Bit Address	Word Address	32 bit	Remarks
Input Relay	I0000 - I1777	R40400 - R40477	<b>L / H</b>	<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Output Relay	Q0000 - Q1777	R40500 - R40577		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
All Station Transmission Relay (Input)	GI0000 - GI3777	R40000 - R40177		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Special Station Transmission Relay (Output)	GQ0000 - GQ3777	R40200 - R40377		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Internal Relay	M0000 - M3777	R40600 - R40777		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Special Relay	SP000 - SP777	R41200 - R41237		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Timer (Contact)	T000 - T377	R41100 - R41117		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Counter (Contact)	C000 - C377	R41140 - R41157		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Stage	S0000 - S1777	R41000 - R41077		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Timer (Elapsed Value)	-	R0000 - R0377		<span style="border: 1px solid black; padding: 2px;">OCT 8</span>
Counter (Elapsed Value)	-	R1000 - R1377		<span style="border: 1px solid black; padding: 2px;">OCT 8</span>
Data Register 1	-	R400 - R777		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> <span style="border: 1px solid black; padding: 2px;">BIT 15</span>
Data Register 2	-	R1400 - R7377		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> <span style="border: 1px solid black; padding: 2px;">BIT 15</span>
Special Register	-	R7400 - R7777		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> <span style="border: 1px solid black; padding: 2px;">BIT 15</span>
Data Register 3	-	R10000 - R37777	<span style="border: 1px solid black; padding: 2px;">OCT 8</span> <span style="border: 1px solid black; padding: 2px;">BIT 15</span>	

\*1 When bits are written, the Display reads the corresponding word address from the External Device, sets particular bits of that word address to ON, and then returns the resulting address to the External Device. Note that the correct data may not be written if you change the word address using the ladder program while the Display reads data from the External Device and returns it.

#### NOTE

- Please refer to the GP-Pro EX Reference Manual for system data area.

Cf. GP-Pro EX Reference Manual "Appendix 1.4 LS Area (only for direct access method)"

- Please refer to the precautions on manual notation for icons in the table.

 "Manual Symbols and Terminology"

## ■ KOSTAC SU Series

     : This address can be specified as system data area.


Device	Bit Address	Word Address	32 bit	Remarks
Input Relay	I000 - I477	R40400 - R40423	<b>L/H</b>	<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Output Relay	Q000 - Q477	R40500 - R40523		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Link Relay/Link Input	GI0000 - GI1777	R40000 - R40077		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Internal Relay	M0000 - M1777	R40600 - R40677		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Special Relay	SP000 - SP137 SP320 - SP717	R41200 - R41205 R41215 - R41234		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Timer (Contact)	T000 - T377	R41100 - R41117		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Counter (Contact)	C000 - C177	R41140 - R41147		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Stage	S0000 - S1777	R41000 - R41077		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Timer (Elapsed Value)	-	R0000 - R0377		<span style="border: 1px solid black; padding: 2px;">OCT 8</span>
Counter (Elapsed Value)	-	R1000 - R1177		<span style="border: 1px solid black; padding: 2px;">OCT 8</span>
Data Register	-	R1400 - R7377		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> <span style="border: 1px solid black; padding: 2px;">BIT 15</span>
Special Register *2	-	R700 - R737 R7400 - R7777		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> <span style="border: 1px solid black; padding: 2px;">BIT 15</span>
Extension Register *3	-	R10000 - R17777		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> <span style="border: 1px solid black; padding: 2px;">BIT 15</span>

\*1 When bits are written, the Display reads the corresponding word address from the External Device, sets particular bits of that word address to ON, and then returns the resulting address to the External Device. Note that the correct data may not be written if you change the word address using the ladder program while the Display reads data from the External Device and returns it.

\*2 Data cannot be written. R700 to R737 of the special register are only available to SU-6B.

\*3 Available only to SU-6B.

### NOTE

- Please refer to the GP-Pro EX Reference Manual for system data area.
  - Cf. GP-Pro EX Reference Manual "Appendix 1.4 LS Area (only for direct access method)"
  - Please refer to the precautions on manual notation for icons in the table.
-  "Manual Symbols and Terminology"

## ■ KOSTAC SZ Series

     : This address can be specified as system data area.

Device	Bit Address	Word Address	32 bit	Remarks
Input Relay	I0000 - I0477	R40400 - R40423	<b>L/H</b>	<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Output Relay	Q0000 - Q0477	R40500 - R40523		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Internal Relay	M0000 - M0377	R40600 - R40617		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Special Relay	SP000 - SP137 SP320 - SP617	R41200 - R41205 R41215 - R41230		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Timer (Contact)	T000 - T177	R41100 - R41107		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Counter (Contact)	C000 - C177	R41140 - R41147		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Stage	S000 - S777	R41000 - R41037		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Timer (Elapsed Value)	-	R000 - R177		<span style="border: 1px solid black; padding: 2px;">OCT 8</span>
Counter (Elapsed Value)	-	R1000 - R1177		<span style="border: 1px solid black; padding: 2px;">OCT 8</span>
Data Register	-	R2000 - R3777		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> <span style="border: 1px solid black; padding: 2px;">BIT 15</span>
Special Register	-	R7746 - R7777		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> <span style="border: 1px solid black; padding: 2px;">BIT 15</span>

\*1 When bits are written, the Display reads the corresponding word address from the External Device, sets particular bits of that word address to ON, and then returns the resulting address to the External Device. Note that the correct data may not be written if you change the word address using the ladder program while the Display reads data from the External Device and returns it.

### NOTE

- Please refer to the GP-Pro EX Reference Manual for system data area.
- Cf. GP-Pro EX Reference Manual "Appendix 1.4 LS Area (only for direct access method)"
- Please refer to the precautions on manual notation for icons in the table.
  - ☞ "Manual Symbols and Terminology"

## ■ KOSTAC PZ3 Series

L/H : This address can be specified as system data area.

Device	Bit Address	Word Address	32 bit	Remarks
Input Relay	I0000 - I0777	R40400 - R40437	<span style="border: 1px solid black; padding: 2px;">L/H</span>	<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Output Relay	Q0000 - Q0777	R40500 - R40537		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Internal Relay	M0000 - M1777	R40600 - R40677		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Special Relay	SP000 - SP777	R41200 - R41237		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Timer (Contact)	T000 - T377	R41100 - R41117		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Counter (Contact)	C000 - C377	R41140 - R41147		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Stage	S0000 - S1777	R41000 - R41037		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Timer (Elapsed Value)	-	R00000 - R41177		<span style="border: 1px solid black; padding: 2px;">OCT 8</span>
Counter (Elapsed Value)	-	R01000 - R41147		<span style="border: 1px solid black; padding: 2px;">OCT 8</span>
Data Register	-	R1400 - R7377 R10000 - R17777		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> <span style="border: 1px solid black; padding: 2px;">BIT 15</span>
Special Register	-	R41200 - R41237		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> <span style="border: 1px solid black; padding: 2px;">BIT 15</span>

\*1 When bits are written, the Display reads the corresponding word address from the External Device, sets particular bits of that word address to ON, and then returns the resulting address to the External Device. Note that the correct data may not be written if you change the word address using the ladder program while the Display reads data from the External Device and returns it.

### NOTE

- Please refer to the GP-Pro EX Reference Manual for system data area.
- Cf. GP-Pro EX Reference Manual "Appendix 1.4 LS Area (only for direct access method)"
- Please refer to the precautions on manual notation for icons in the table.
  - ☞ "Manual Symbols and Terminology"



## ■ KOSTAC SR Series

     : This address can be specified as system data area.

Device	Bit Address	Word Address	32 bit	Remarks
I/O Relay	000 - 157 700 - 767	R000 - R014 R070 - R076 (first half 1 byte)	<b>L/H</b>	<span style="border: 1px solid black; padding: 2px;">OCT 8</span> <span style="border: 1px solid black; padding: 2px;">+ 2</span> *1
Internal Relay	160 - 377 770 - 777	R016 - R036 R076 (latter half 1 byte)		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> <span style="border: 1px solid black; padding: 2px;">+ 2</span> *1
Shift Register	400 - 577	R040 - R056		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> <span style="border: 1px solid black; padding: 2px;">+ 2</span> *1
Timer/Counter (Contact)	600 - 677	R060 - R066		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> <span style="border: 1px solid black; padding: 2px;">+ 2</span> *1
Timer/Counter (Elapsed Value)	-	R600 - R677		<span style="border: 1px solid black; padding: 2px;">OCT 8</span>
Data Register	-	R400 - R576		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> <span style="border: 1px solid black; padding: 2px;">BIT 15</span> <span style="border: 1px solid black; padding: 2px;">+ 2</span>

\*1 When bits are written, the Display reads the corresponding word address from the External Device, sets particular bits of that word address to ON, and then returns the resulting address to the External Device. Note that the correct data may not be written if you change the word address using the ladder program while the Display reads data from the External Device and returns it.

### NOTE

- Please refer to the GP-Pro EX Reference Manual for system data area.
- Cf. GP-Pro EX Reference Manual "Appendix 1.4 LS Area (only for direct access method)"
- Please refer to the precautions on manual notation for icons in the table.  
☞ "Manual Symbols and Terminology"

## ■ DL-205 Series

     : This address can be specified as system data area.

Device	Bit Address	Word Address	32 bit	Remarks
Input Relay	X0000 - X0477	V40400 - V40423	<b>L/H</b>	<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Output Relay	Y0000 - Y0477	V40500 - V40523		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Control Relay	C0000 - C0377	V40600 - V40617		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Special Relay	SP000 - SP137 SP320 - SP617	V41200 - V41205 V41215 - V41230		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Timer (Contact)	T000 - T177	V41100 - V41107		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Counter (Contact)	CT000 - CT177	V41140 - V41147		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Stage	S000 - S777	V41000 - V41037		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Timer (Elapsed Value)	-	V0000 - V0177		<span style="border: 1px solid black; padding: 2px;">OCT 8</span>
Counter (Elapsed Value)	-	V1000 - V1177		<span style="border: 1px solid black; padding: 2px;">OCT 8</span>
Data Register	-	V2000 - V3777		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> <span style="border: 1px solid black; padding: 2px;">BIT 15</span>
Special Register	-	V7746 - V7777		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> <span style="border: 1px solid black; padding: 2px;">BIT 15</span>

\*1 When bits are written, the Display reads the corresponding word address from the External Device, sets particular bits of that word address to ON, and then returns the resulting address to the External Device. Note that the correct data may not be written if you change the word address using the ladder program while the Display reads data from the External Device and returns it.

### NOTE

- Please refer to the GP-Pro EX Reference Manual for system data area.
- Cf. GP-Pro EX Reference Manual "Appendix 1.4 LS Area (only for direct access method)"
- Please refer to the precautions on manual notation for icons in the table.
  - ☞ "Manual Symbols and Terminology"

## ■ DL-305 Series

     : This address can be specified as system data area.

Device	Bit Address	Word Address	32 bit	Remarks
I/O Relay	000 - 157 700 - 767	V000 - V014 V070 - V076 (first half 1 byte)	<b>L/H</b>	<span style="border: 1px solid black; padding: 2px;">OCT 8</span> <span style="border: 1px solid black; padding: 2px;">÷ 2</span> *1
Control Relay	160 - 377 770 - 777	V016 - V036 V076 (latter half 1 byte)		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> <span style="border: 1px solid black; padding: 2px;">÷ 2</span> *1
Shift Register	400 - 577	V040 - V056		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> <span style="border: 1px solid black; padding: 2px;">÷ 2</span> *1
Timer/Counter (Contact)	600 - 677	V060 - V066		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> <span style="border: 1px solid black; padding: 2px;">÷ 2</span> *1
Timer/Counter (Elapsed Value)	-	V600 - V677		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> <span style="border: 1px solid black; padding: 2px;">÷ 2</span>
Data Register	-	V400 - V576		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> <span style="border: 1px solid black; padding: 2px;">BIT 15</span> <span style="border: 1px solid black; padding: 2px;">÷ 2</span>

\*1 When bits are written, the Display reads the corresponding word address from the External Device, sets particular bits of that word address to ON, and then returns the resulting address to the External Device. Note that the correct data may not be written if you change the word address using the ladder program while the Display reads data from the External Device and returns it.

### NOTE

- Please refer to the GP-Pro EX Reference Manual for system data area.
- Cf. GP-Pro EX Reference Manual "Appendix 1.4 LS Area (only for direct access method)"
- Please refer to the precautions on manual notation for icons in the table.
  - ☞ "Manual Symbols and Terminology"


## ■ DL-405 Series

     : This address can be specified as system data area.

Device	Bit Address	Word Address	32 bit	Remarks
Input Relay	X000 - X477	V40400 - V40423	L/H	<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Output Relay	Y000 - Y477	V40500 - V40523		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Link Relay	GX0000 - GX1777	V40000 - V40077		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Link Output Relay	GY0000 - GY3777	V40200 - V40377		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Control Relay	C0000 - C1777	V40600 - V40677		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Special Relay	SP000 - SP137 SP320 - SP717	V41200 - V41205 V41215 - V41234		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Timer (Contact)	T000 - T377	V41100 - V41117		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Counter (Contact)	CT000 - CT177	V41140 - V41147		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Stage	S0000 - S1777	V41000 - V41077		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Timer (Elapsed Value)	-	V0000 - V0377		<span style="border: 1px solid black; padding: 2px;">OCT 8</span>
Counter (Elapsed Value)	-	V1000 - V1177		<span style="border: 1px solid black; padding: 2px;">OCT 8</span>
Data Register 1	-	V400 - V777		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> <span style="border: 1px solid black; padding: 2px;">BIT 15</span>
Data Register 2	-	V1400 - V7377		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> <span style="border: 1px solid black; padding: 2px;">BIT 15</span>
Special Register	-	V7400 - V7777		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> <span style="border: 1px solid black; padding: 2px;">BIT 15</span>
Data Register 3	-	V10000 - V37777		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> <span style="border: 1px solid black; padding: 2px;">BIT 15</span>

\*1 When bits are written, the Display reads the corresponding word address from the External Device, sets particular bits of that word address to ON, and then returns the resulting address to the External Device. Note that the correct data may not be written if you change the word address using the ladder program while the Display reads data from the External Device and returns it.

**NOTE**

- Please refer to the GP-Pro EX Reference Manual for system data area.
- Cf. GP-Pro EX Reference Manual "Appendix 1.4 LS Area (only for direct access method)"
- Please refer to the precautions on manual notation for icons in the table.
  -  "Manual Symbols and Terminology"

## ■ Direct Logic 05 Series


     : This address can be specified as system data area.

Device	Bit Address	Word Address	32 bit	Remarks
Input Relay	I0000 - I0377	R40400 - R40417	<b>L / H</b>	<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Output Relay	Q0000 - Q0377	R40500 - R40517		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Internal Relay	M0000 - M0777	R40600 - R40637		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Special Relay	SP000 - SP777	R41200 - R41237		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Timer (Contact)	T000 - T177	R41100 - R41107		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Counter (Contact)	C000 - C177	R41140 - R41147		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Stage	S000 - S377	R41000 - R41017		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Timer (Elapsed Value)	-	R000 - R177		<span style="border: 1px solid black; padding: 2px;">OCT 8</span>
Counter (Elapsed Value)	-	R1000 - R1177		<span style="border: 1px solid black; padding: 2px;">OCT 8</span>
V-Memory	-	R1200 - R7377		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> <span style="border: 1px solid black; padding: 2px;">BIT 15</span> *2
V-Memory Nonvolatile	-	R7400 - R7577		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> <span style="border: 1px solid black; padding: 2px;">BIT 15</span>
System Parameter	-	R7600 - R7777		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> <span style="border: 1px solid black; padding: 2px;">BIT 15</span>

\*1 When bits are written, the Display reads the corresponding word address from the External Device, sets particular bits of that word address to ON, and then returns the resulting address to the External Device. Note that the correct data may not be written if you change the word address using the ladder program while the Display reads data from the External Device and returns it.

\*2 No bits can be set for R1200 to R1377.

### NOTE

- Please refer to the GP-Pro EX Reference Manual for system data area.
  - Cf. GP-Pro EX Reference Manual "Appendix 1.4 LS Area (only for direct access method)"
  - Please refer to the precautions on manual notation for icons in the table.
-  "Manual Symbols and Terminology"

## ■ Direct Logic 06 Series

     : This address can be specified as system data area.

Device	Bit Address	Word Address	32 bit	Remarks
Input Relay	I0000 - I0777	R40400 - R40437	<b>L / H</b>	<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Output Relay	Q0000 - Q0777	R40500 - R40537		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Internal Relay	M0000 - M1777	R40600 - R40677		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Special Relay	SP000 - SP777	R41200 - R41237		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Timer (Contact)	T000 - T377	R41100 - R41117		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Counter (Contact)	C000 - C177	R41140 - R41147		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Stage	S0000 - S1777	R41000 - R41147		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> *1
Timer (Elapsed Value)	-	R000 - R377		<span style="border: 1px solid black; padding: 2px;">OCT 8</span>
Counter (Elapsed Value)	-	R1000 - R1177		<span style="border: 1px solid black; padding: 2px;">OCT 8</span>
V-Memory	-	R0400 - R0677 R1200 - R7377 R1000 - R1777		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> <span style="border: 1px solid black; padding: 2px;">BIT 15</span> *2
V-Memory Nonvolatile	-	R7400 - R7577		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> <span style="border: 1px solid black; padding: 2px;">BIT 15</span>
System Parameter	-	R700 - R777 R7600 - R7777 R3600 - R3777		<span style="border: 1px solid black; padding: 2px;">OCT 8</span> <span style="border: 1px solid black; padding: 2px;">BIT 15</span>

\*1 When bits are written, the Display reads the corresponding word address from the External Device, sets particular bits of that word address to ON, and then returns the resulting address to the External Device. Note that the correct data may not be written if you change the word address using the ladder program while the Display reads data from the External Device and returns it.

\*2 No bits can be set for R1200 to R1377.

### NOTE

- Please refer to the GP-Pro EX Reference Manual for system data area.
- Cf. GP-Pro EX Reference Manual "Appendix 1.4 LS Area (only for direct access method)"
- Please refer to the precautions on manual notation for icons in the table.
- ☞ "Manual Symbols and Terminology"

## 7 Device Code and Address Code

Use device code and address code when you select "Device Type & Address" for the address type of the data display or other devices.

### ■KOSTAC SG/KOSTAC SU/KOSTAC SZ/KOSTAC PZ3/Direct Logic 05/Direct Logic 06 Series

Device	Device Name	Device Code (HEX)	Address Code
Input Relay	I/R	0080	Word Address
Output Relay	Q/R	0081	Word Address
Link Relay	GI/R	0082	Word Address
Link Output Relay	GQ/R	0083	Word Address
Internal Relay	M/R	0084	Word Address
Special Relay	SP/R	0085	Word Address
Timer (Contact)	T/R	00E0	Word Address
Counter (Contact)	C/R	00E1	Word Address
Stage	S/R	0004	Word Address
Timer (Elapsed Value)	R	0060	Word Address
Counter (Elapsed Value)	R	0061	Word Address
Data Register 1	R	0000	Word Address
Data Register 2	R	0001	Word Address
Special Register	R	0002	Word Address
Data Register 3	R	0003	Word Address

### ■KOSTAC SR Series

Device	Device Name	Device Code (HEX)	Address Code
I/O Relay (R000 - R014)	.../R	0080	Value of word address divided by 2
I/O Relay (R070 - R076)			
Internal Relay (R016 - R036)			
Internal Relay (R076)			
Shift Register			
Timer/Counter (Contact)			
Timer/Counter (Elapsed Value)	R	0060	Word Address
Data Register	R	0000	Value of word address divided by 2

### ■DL-205/DL-405 Series

Device	Device Name	Device Code (HEX)	Address Code
Input Relay	X/V	0080	Word Address
Output Relay	Y/V	0081	Word Address
Link Relay	GX/V	0082	Word Address
Link Output Relay	GY/V	0083	Word Address
Control Relay	C/V	0084	Word Address
Special Relay	SP/V	0085	Word Address
Timer (Contact)	T/V	00E0	Word Address
Counter (Contact)	CT/V	00E1	Word Address
Stage	S/V	0004	Word Address
Timer (Elapsed Value)	V	0060	Word Address
Counter (Elapsed Value)	V	0061	Word Address
Data Register 1	V	0000	Word Address
Data Register 2	V	0001	Word Address
Special Register	V	0002	Word Address
Data Register 3	V	0003	Word Address



## ■DL-305 Series

Device	Device Name	Device Code (HEX)	Address Code
I/O Relay (V000 - V014)	.../V	0080	Value of word address divided by 2
I/O Relay (V070 - V076)			
Control Relay (V016 - V036)			
Control Relay (V076)			
Shift Register			
Timer/Counter (Contact)			
Timer/Counter (Elapsed Value)	V	0060	Word Address
Data Register	V	0000	Value of word address divided by 2

## 8 Error Messages

Error messages are displayed on the Display screen as follows: "No.: Device Name: Error Message (Error Occurrence Area)". Each description is shown below.

Item	Description
No.	Error No.
Device Name	Name of the External Device where an error has occurred. Device name is the title of the External Device set with GP-Pro EX. ((Initial value [PLC1])
Error Message	Displays messages related to an error that has occurred.
Error Occurrence Area	<p>Displays the IP address or device address of the External Device where an error has occurred, or error codes received from the External Device.</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>• IP address is displayed as "IP address (Decimal): MAC address (Hex)".</li> <li>• Device address is displayed as "Address: Device address".</li> <li>• Received error codes are displayed as "Decimal [Hex]".</li> </ul>

Display Examples of Error Messages

"RHAA035: PLC1: Error has been responded for device write command (Error Code: 01H)"

**NOTE**

- Please refer to the manual of the External Device for more details on received error codes.
- Please refer to "When an error is displayed (Error Code List)" in "Maintenance/Troubleshooting manual" for more details on the error messages common to the driver.

### ■ Error Codes Specific to the External Device

Error codes specific to the External Device are shown below.

Error Code	Description
01	A timeout has occurred on the serial link.
04	Unavailable I/O data has been requested.
0C	During the header transfer, an error has occurred even after three retries.
0D	During the data transfer, an error has occurred even after three retries.
14	<p>During the data block transfer, one or more of the following errors have occurred:</p> <ul style="list-style-type: none"> <li>- Invalid STX has been received.</li> <li>- Invalid ETB has been received.</li> <li>- Invalid ETX has been received.</li> <li>- Invalid LRC has been received.</li> <li>- A parity error, framing error, or overrun error has occurred.</li> </ul>
15	EOT reception from the parent station has resulted in failure.
16	ACK/NAC reception has resulted in failure during the wait state.

Error Code	Description
1D	Except during the header/data transfer, one or more of the following errors have occurred: <ul style="list-style-type: none"><li>- Invalid STX has been received.</li><li>- Invalid ETB has been received.</li><li>- Invalid ETX has been received.</li><li>- Invalid LRC has been received.</li><li>- A parity error, framing error, or overrun error has occurred.</li></ul>
1E	During the header transfer, one or more of the following errors have occurred: <ul style="list-style-type: none"><li>- Invalid SOH has been received.</li><li>- Invalid ETB has been received.</li><li>- Invalid LRC has been received.</li><li>- A parity error, framing error, or overrun error has occurred.</li></ul>

